

# Fire Safety Analysis Manual for LP-Gas Storage Facilities

*Based on the 2014 Edition of NFPA 58 Liquefied Petroleum Gas Code*



**Developed by the National Fire Protection Association and the  
National Propane Gas Association**

**Funded by a Grant from the Propane Education & Research Council**



# Fire Safety Analysis Manual For LP-Gas Storage Facilities

Based on the 2014 Edition of NFPA 58 *Liquefied Petroleum Gas Code*

The official position of the NFPA on all aspects regarding propane storage facility safety is in NFPA 58, the *Liquefied Petroleum Gas Code*. This manual is not intended to replace NFPA 58.

The Propane Education & Research Council (PERC) is a non-profit 501(c)6 trade organization authorized by the Propane Education and Research Act of 1996 (PERA), Public Law 104-284. PERC was created “to enhance consumer and employee safety and training, to provide for research and development of clean and efficient propane utilization equipment, and to inform and educate the public about safety and other issues associated with the use of propane.”

PERC is governed by a twenty-one member Board of Directors appointed by the National Propane Gas Association (NPGA) and the Gas Processors Association (GPA). PERC program beneficiaries include propane retail marketers, producers, transporters’ and agricultural cooperatives, as well as representatives of allied service and supply industries (industry members).

The recommendations, standards, or recommended practices, as reflected in this document, were developed by independent consultants retained by PERC. While PERC administers the process of obtaining the information, it does not independently test or verify the accuracy of the information or methods used to collect the data that supports the conclusions or recommendations reflected in this document.

PERC, NPGA, GPA and the industry members disclaim any liability for any personal injury, property damage, business losses or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use, or reliance on this document, or any information, apparatus, method, process, or similar item disclosed in this document. This disclaimer of liability shall apply even if such loss or damage results, in whole or in part, from any acts or omissions of or by any negligence on the part of PERC, NPGA, GPA or industry members or any persons who contributed to the development of the information contained in this document. PERC, NPGA, GPA and industry members make no warranty or guaranty as to the accuracy or completeness of any information published in this document.

The procedures and information in this document are intended to implement the standards set forth in the documents referenced with capabilities of the personnel and equipment available. It does not create new standards or criteria for compliance. The order of steps

in any procedure may or may not be of importance. This material is not sold nor is it a product of any consulting or engineering activity.

Users of this document should consult the law of their individual jurisdictions for codes, standards and legal requirements applicable to them. This document is not intended nor should it be construed to (1) set forth policies or procedures which are the general custom or practice in the propane industry; (2) to establish the legal standards of care owed by propane distributors to their customers; or (3) to prevent the user from using different methods to implement applicable codes, standards or legal requirements.

By disseminating or publishing this document, PERC is not undertaking to render any professional or other service to or on behalf of any person or entity. PERC, NPGA, GPA and the industry members are not undertaking to perform any duty owed by any person or entity to any third party. Anyone reading or using this document should rely on his or her own judgment or, as appropriate, should seek the advice of a competent professional in determining the exercise of reasonable care in any and all circumstances.

## Origin and Development of the Fire Safety Analysis Manual

The requirement for a Fire Safety Analysis (FSA) was introduced in the 1976 edition of NFPA 58, along with the requirement for emergency shutoff valves at locations where hoses and swivel type piping were used (for connection to cargo tank vehicles and rail cars). A Fire Safety Analysis was required for new propane storage plants with capacities of more than 4,000 gallons located in “heavily populated or congested areas”.

This requirement was basically unchanged until the 2001 edition of NFPA 58, where the FSA was required for all propane storage plants with capacities of more than 4,000 gallons, with a three year period for existing facilities to be brought into compliance. As the majority of plants requiring a FSA did not have one in 2001, the need for guidance on how to conduct the FSA became apparent. Prior to 2001, the FSA was usually conducted by an independent consultant with knowledge of propane and fire safety. The concept of a consistent methodology was identified by a propane marketer in New England, Jim Hurley of Eastern Propane. The first two editions of the Manual were dedicated to Jim in recognition of his vision.

The recommendation resulted in NFPA working with NPGA to submit a proposal to PERC to develop a FSA manual to assist marketers in complying with the FSA requirement. When the project was approved, NPGA established an advisory committee and worked with NFPA to develop the manual.

Since the 2001 edition of the manual, it has been updated thrice to retain correct numbers of the paragraphs referenced in NFPA 58, as they are sometimes revised and renumbered. No technically substantive changes have been made to the manual since the first edition was published.

The models used in the Fire Safety Analysis (FSA) Manual to determine the distances to hazards (presented in Table B-1 of the FSA Manual) are based on published models in the literature. These models have been published in government reports, journal articles<sup>1,2</sup>, EPA-suggested procedures<sup>3</sup> and engineering monographs and books. The models used are considered conservative and have been simplified for the purposes of the FSA Manual.

---

<sup>1</sup> A general reference on hazard distance assessment models is: Lees, F.P. (Editor), “*Loss Prevention in the Process Industries*,” 2<sup>nd</sup> Edition, Vol 1, 2 & 3, Butterworth Heinemann Publishers, Oxford, England, 1996.

<sup>2</sup> Raj, P.K., “*Exposure of a liquefied gas container to an external fire*,” *Journal of Hazardous Materials*, v 122, Issues 1-2, p 37-49, June 2005.

<sup>3</sup> US EPA, “*Technical Guidance for Hazard Analysis*,” *Emergency Planning for Extremely Hazardous Substances*, EPA/FEMA/DOT, December 1987.

## Acknowledgments

This fifth edition of the Fire Safety Analysis (FSA) Manual, based on the 2014 edition of NFPA 58, is a continuation of the effort to fulfill a need for an easily used and simple aid for the members of propane industry to fulfill their obligations under NFPA 58 (2001, 2004, 2008, 2011 and 2014 editions) which require developing a written FSA. The project was funded by the Propane Education & Research Council through the National Propane Gas Association (NPGA). The National Fire Protection Association (NFPA) was the principal contractor for the first edition of the manual. Technology & Management Systems, Inc. (TMS) developed the technical analyses and several chapters of the first edition of the manual, as a subcontractor to NFPA.

Mr. Theodore C. Lemoff, Principal Gases Engineer, was the principal investigator at NFPA. Dr. Phani K. Raj was the principal investigator and analyst at TMS. Mr. Bruce Swiecicki, P.E., Senior Technical Advisor at NPGA, served as a staff technical reviewer.

In preparation for the first edition, NPGA assembled an Advisory Committee consisting of representatives from the propane industry, a Fire Department of a major city in the US and a Fire Protection Engineer. The Committee provided technical inputs and guidance to the project team on industry safety practices, types of information that an authority having jurisdiction and emergency responders would want to see in an FSA, an insight into the levels of understanding of various issues related to FSA in the industry, etc. The Advisory Committee set not only the direction of the project but made policy decisions related to the scope of the FSA manual. Except for the contractors, every member of the Advisory Committee had a vote and many decisions were made on the basis of a Committee vote. The Advisory Committee consisted of the following (voting) members.

1	Michael Merrill ( <b>Chairman</b> )	Suburban Propane LP	Whippany, NJ
2	Mr. Greg Benton	Georgia Gas Distributors	Atlanta, GA
3	Mr. Billy Cox	O'Nealgas Inc.	Choudrant, LA
4	Mr. James Howe	Howe Engineers, Inc.	West Falmouth, MA
5	Mr. Jerry Lucas	Heritage Propane Partners, LP	Sallisaw, OK
6	Mr. Rob Scott	Scott & Associates	Kingsburg, CA
7	Mr. Cliff Slisz	Ferrellgas	Liberty, MO
8	Mr. Scott Stookey	City of Phoenix Fire Department	Phoenix, AZ
9	Mr. Ron Stover	Mutual Liquid Gas & Equipment	Gardena, CA
10	Mr. Robert Wallace	Dowdle Butane Gas Co Inc	Maryville, TN
11	Mr. Brent Wolcott	Ag Valley Coop	Edison, NE

Mr. Theodore Lemoff and Dr. Phani Raj participated in the deliberations of the meetings of the Advisory Committee as non-voting members.

## About the Authors

### **Phani K. Raj, Ph.D.**

Dr. Raj is the President of Technology & Management Systems, Inc. (TMS). He holds S.M. and Ph.D. degrees in Mechanical Engineering as well as an MBA degree.

He has over 30 years professional experience in conducting safety research and assessing risks in the storage, transportation, handling and utilization of hazardous materials, including energy fluids. His research has included the development of mathematical models to describe the accidental release behavior of chemicals and flammable materials. In addition, he has developed easy to follow safety guideline documents and hazard assessment manuals for a number of clients including the Federal Agencies and industrial clients.

Dr. Raj developed a number of models for the “Chemical Hazard Response Information System” (CHRIS), which the U.S. Coast Guard and the National Response Center use for assisting in case of hazardous material emergencies. He is the author of CHRIS Manual III “Hazard Assessment Handbook.”

Since 1996 he has been a member of the NFPA’s Technical Committee on Liquefied Petroleum Gases which writes NFPA 58, *Liquefied Petroleum Gas Code*. He was a member of the Committee Transportation of Hazardous Materials (of the National Research Council), and emeritus member of the Editorial Board of the Journal of Hazardous Materials. He has held the post of visiting lecturer at MIT and taught, in the Chemical Engineering Department, a graduate level course. He is the principal author of over 100 technical reports and over 40 technical papers.

### **Theodore C. Lemoff, PE**

Mr. Lemoff is retired from the National Fire Protection Association (NFPA). While at NFPA, he served as the Principal Gases Engineer. He holds a Bachelor of Engineering degree in Chemical Engineering and is a registered professional engineer in Massachusetts.

He has over 40 years experience in the fire safety and the chemical industry, including 25 years at NFPA working in the flammable gases area. He served as the staff liaison and secretary to the NFPA Technical Committee on Liquefied Petroleum Gases, responsible for NFPA 58, and for other NFPA codes and standards on flammable gases.

Mr. Lemoff is a member of the American Institute of Chemical Engineers, the Society of Fire Protection Engineers, the Society of Gas Engineers, and the American Society of Plumbing Engineers.

# Table of Contents

	<b>Page #</b>
<b>Origin and Development of the Fire Safety Analysis Manual</b>	(ii)
<b>Acknowledgments</b>	(iv)
<b>About the authors</b>	(v)
<b>CHAPTER 1 Introduction</b>	
1.1 Background	1-1
1.2 Scope of the Manual	1-2
1.3 Need for a FSA Manual	1-3
1.4 LP-Gas Safety Record and Risks	1-4
1.5 Organization of the FSA Manual	1-5
<b>CHAPTER 2 LP-Gas Storage Container Safety Features</b>	
2.1 A Historical Perspective	2-1
2.2 Current LP-Gas Storage Container Safety Features	2-3
<b>CHAPTER 3 Principal Elements of Fire Safety Analysis</b>	
3.1 Important Steps in Conducting the Analysis	3-1
3.2 Completing the FSA	3-2
<b>CHAPTER 4 Facility Information</b>	
4.1 Initial Data for the LP-Gas Facility	4-1
4.2 Facility Storage Capacity and Other Details	4-1
4.3 Additional Facility Information	4-2
<b>CHAPTER 5 Analysis of Product Control Measures in Containers and Transfer Piping</b>	
5.1 Product Control Measures in Containers	5-1
5.1.1 Individual Containers of Water Capacity less than or equal to 2,000 gallons	5-2
5.1.2 Individual Containers greater than 2,000 gallons water capacity and less than or equal to 4,000 gallons water capacity	5-8
A) Containers used in Residential and Commercial Facilities	5-8
B) Containers used in Bulk and Industrial Facilities	5-11
5.1.3 Individual Containers of Water Capacity greater than 4,000 gallons used in Bulk Plants and Industrial Plants	5-17
5.2 Product Control Measures in Transfer Piping	5-23
5.2.1 Manifolder and Remotely Filled Containers	5-23
5.3 Alternate Provisions for the Installation of ASME Containers	5-26
5.3.1 ASME Container Appurtenances and Redundant Fail-Safe Product Control Systems	5-26
5.3.2 Low Emission Transfer Equipment	5-28

<b>CHAPTER 6</b>		<b>Analysis of Local Conditions of Hazard</b>	
6.1	Physical Protection Measures		6-1
6.2	Ignition Sources and Control		6-2
6.3	Separation Distances		6-3
	6.3.1 Separation Distances between Container and Important Buildings, Other Properties and Transfer Points		6-3
	6.3.2 Separation Distances between Transfer Points and other Exposures		6-4
6.4	Special Protection		6-5
6.5	Vehicular Protection		6-6
<b>CHAPTER 7</b>		<b>Exposure to and from Other Properties, Population Density</b>	
7.1	Exposure to off-site properties and persons from in-plant propane releases		7-1
7.2	Exposure to Propane Plants From External Events		7-3
<b>CHAPTER 8</b>		<b>Evaluation of Fire Services and Water Supply Requirements</b>	
8.1	Details of the Fire Service		8-1
8.2	Water Needs and Availability		8-3
<b>CHAPTER 9</b>		<b>Evaluation Summary for a Proposed New LP-Gas Facility</b>	
<b>CHAPTER 10</b>		<b>Fire Safety Analysis Examples</b>	
10.1	Illustrative Example # 1		10-2
10.2	Illustrative Example # 2		10-21
10.3	Illustrative Example # 3		10-39
10.4	Illustrative Example # 4		10-57
<b>Glossary and Acronyms</b>			G-1
<b>Appendix A: Fill-In Forms</b>			A-1
<b>Appendix B: Results of Hazard Distance Calculations for Different LPG Release Scenarios</b>			B-1

---

Copyright 2015 Propane Education & Research Council. All rights reserved. Reproduction of this publication in other than its entirety is prohibited without permission in writing from the Propane Education & Research Council and the authors.

## List of Forms

		<b>Page #</b>
Form 4.1	Initial Data on the LP-Gas Facility	4-1
Form 4.2	Facility Storage Capacity	4-2
Form 4.3	Additional Information on the LP-Gas Facility	4-3
Form 5.1	Compliance with Code Requirements for Appurtenances on Containers of 2,000 Gallons Water Capacity or Less	5-3
Form 5.2	Compliance with Code Requirements for Appurtenances on Containers of Water Capacity 2,001 Gallons Through 4,000 Gallons Used in Residences and Commercial Facilities	5-10
Form 5.3	Compliance with Code Requirements for Appurtenances on Containers of Water Capacity 2,001 Gallons Through 4,000 Gallons Used in Bulk Plants and Industrial Plants	5-12
Form 5.4	Compliance with Code Requirements for Appurtenances on Containers of Greater than 4,000 Gallons Water Capacity Used in Bulk Plants and Industrial Plants	5-18
Form 5.5	Requirements for Transfer Lines of 1½ inch Diameter or Larger, Liquid-into-Containers	5-23
Form 5.6	Requirements for Transfer Lines of 1½ inch Diameter or Larger, Liquid Withdrawal from Containers	5-24
Form 5.7	Requirements for Vapor Transfer Lines 1¼-inch Diameter or Larger	5-25
Form 5.8	Evaluation of Redundant Fail-Safe Design	5-26
Form 5.9	Evaluation of Low Emission Transfer Equipment	5-28
Form 6.1	Evaluation of Physical Protection and Other Measures	6-1
Form 6.2	Ignition Source Control Assessment	6-2
Form 6.3	Separation Distances between Containers and Buildings, Property Line, etc.	6-3
Form 6.4	Separation Distances between Points of Transfer and Other Exposures	6-4
Form 6.5	Special Protection Measures, Passive Systems	6-5
Form 6.6	Special Protection Measures, Active Systems	6-6
Form 6.7	Protection Against Vehicular Impact	6-6
Form 7.1	Types of Occupancies Near or Surrounding the LP-Gas Plant	7-3
Form 7.2	Exposure to LP-Gas Plant from External Hazards	7-4
Form 8.1	Data on the Responding Fire Department	8-2
Form 8.2	Response Time Data for the Fire Departments	8-4
Form 8.3	Water Flow Rate and Total Water Volume Required to Cool Containers Exposed to a Fire	8-5
Form 8.4	Evaluation of Water Availability in or Near the LP-Gas Facility	8-7
Form 9.1	Analysis Summary on Product Control and Local Conditions of Hazard	9-1
Form 9.2	Analysis Summary on Exposure From and to the LP-Gas Facility	9-2
Form 9.3	Analysis Summary on Fire Department Evaluations	9-3

Form 9.4	Redundant and Fail-Safe Design for Containers	9-5
Form 9.5	Low Emission Transfer Equipment	9-6
Form 9.6	Special Protection Measures –Passive Systems	9-7
Form 9.7	Special Protection Measures –Active Systems	9-7

### **List of Tables**

Table 3.1	Description of the Various Steps in Performing the FSA	3-3
Table 5.1	Container Size Dependant Evaluations	5-1
Table 7.1	Distances to Various Types of Propane Hazards Under Different Release Models	7-2
Table 9.1	Suggested Alternative Methods for Industrial and Bulk Plants That Do Not Pose a Hazard But Lack a Water Supply	9-8
Table B-1	LPG Release Cases for Hazard Assessment	B-2
Table B-2	Distances to LFL Concentrations and Hazard Areas	B-4
Table B-3	Various Parameters and their Values Used in the Cases	B-6
Table B-4	Thermodynamic Properties of Propane	B-7
Table B-5	Calculation of the Mass Fraction of LPG and n-Butane	B-9

## List of Figures

	<b>Page #</b>
Figure 5-1 Schematic Representation of the NFPA 58 Requirements for Product Control Appurtenances on Containers of Water Capacity Less Than or Equal to 2,000 Gallons, With Different Service Configurations	5-4
Figure 5-1A: Single Vapor Service Line in a Manifolder Configuration	5-4
Figure 5-1B: Regulator in the Vapor Service Line	5-5
Figure 5-1C: Container with both Liquid and Vapor Service, Regulator in the Vapor Service Line	5-6
Figure 5-1D: Container Feeding Liquid to a Vaporizer	5-7
Figure 5-1E: Vertical Container for Liquid Service	5-8
Figure 5-2 Vapor Inlet Appurtenances on Containers of Water Capacity Greater Than 2,000 Gallons	5-13
Figure 5-3 Vapor Outlet Appurtenances on Containers of Water Capacity Greater Than 2,000 Gallons	5-14
Figure 5-4 Liquid Inlet Valves on Containers 2,001 through 4,000 Gallons Water Capacity	5-15
Figure 5-5 Liquid Outlet Valves on Containers 2,001 through 4,000 Gallons Water Capacity	5-16
Figure 5-6A Liquid Inlet Valves on Containers with Water Capacity Greater Than 4,000 Gallons in New Bulk Plants and Industrial Plants	5-19
Figure 5-6B Liquid Inlet Valves on Containers with Water Capacity Greater Than 4,000 Gallons in Existing Bulk Plants and Industrial Plants	5-20
Figure 5-7A Liquid Outlet Valves on Containers with Water Capacity Greater Than 4,000 Gallons in New Bulk Plants and Industrial Plants	5-21
Figure 5-7B Liquid Outlet Valves on Containers with Water Capacity Greater Than 4,000 Gallons in Existing Bulk Plants and Industrial Plants	5-22

# CHAPTER 1

## Introduction

### 1.1 Background

The Fire Safety Analysis (FSA) is a self-conducted audit of the safety features of a propane installation and an assessment of the means to minimize the potential for inadvertent propane releases from storage containers and during transfer operations. The assessment also includes an evaluation of the capabilities of local emergency response agencies as well as an analysis of potentially hazardous exposures from the installation to the neighborhood and from the surroundings to the LP-Gas facility.

Since 1976, NFPA 58, *Liquefied Petroleum Gas Code* (hereinafter referred to as the “code” or “NFPA 58”) has required that a facility operator or owner conduct a FSA for propane facilities having ASME containers of aggregate storage greater than 4,000 gallons water capacity. The FSA requirement was changed in the 2001 edition to require a written FSA. The requirements for fire protection are indicated in the 2014 edition of NFPA 58 in §6.27, which addresses fire protection requirements for industrial plants, bulk plants and dispensing stations. Specifically §6.27.2 (“Planning”) and §6.27.3 (“Protection of ASME Containers”) require, in part, the following:

- 6.27.2.1** The planning for the response to incidents including the inadvertent release of LP-Gas, fire, or security breach shall be coordinated with local emergency response agencies.
- 6.27.2.2** Planning shall include consideration of the safety of emergency personnel, workers, and the public.
- 6.27.3.1** Fire protection shall be provided for installations with an aggregate water capacity of more than 4000 gal (15.2 m<sup>3</sup>) and for ASME containers on roofs.
- 6.27.3.2** The modes of fire protection shall be specified in a written fire safety analysis for new installations, for existing installations that have an aggregate water capacity of more than 4000 gallons (15.2 m<sup>3</sup>) and for ASME containers on roofs. Existing installations shall comply with this requirement within 2 years of the effective date of this code.
- 6.27.3.3** The fire safety analysis shall be submitted by the owner, operator, or their designee to the authority having jurisdiction and local emergency responders.
- 6.27.3.4** The fire safety analysis shall be updated when the storage capacity or transfer system is modified.

The FSA and required assessment of the installation provides several important benefits:

- 1) A structured assessment by which each facility can be evaluated for conformity of installed equipment with code requirements.

- 2) A means to evaluate the capability of systems and equipment installed to control and contain potential LP-Gas releases during day-to-day operations.
- 3) An approach to evaluate the informational needs of the facility, based on factors such as the type and frequency of transfer operations, size of the storage containers, location of the facility with respect to other buildings and the existing procedures and systems in place.
- 4) A means to describe product control and fire protection features which exceed the comprehensive requirements of NFPA 58<sup>1</sup>.
- 5) A tool for facilitating a cooperative and effective dialogue with local emergency response agencies and authorities having jurisdiction.

## 1.2 Scope of the Manual

The manual addresses a number of subjects, including:

- (1) A review of the product control measures required in the NFPA 58, “Liquefied Petroleum Gas Code”
- (2) Local conditions of hazards within the facility site
- (3) Exposures to and from other properties
- (4) Effectiveness of local fire departments
- (5) Effective control of leakage, fire and exposure
- (6) Illustrative examples using four different sizes of typical LP-Gas facilities

This FSA manual is intended for use by propane plant owners or operators, consultants, authorities having jurisdiction (AHJs) and emergency response personnel. The manual addresses the process by which a FSA can be conducted for a LP-Gas facility containing one or more stationary ASME containers.

The FSA manual is designed to provide a guide for identifying the requirements in NFPA 58 and determining compliance with them. Section 6.27.3.5 of NFPA 58 provides that:

The fire safety analysis shall be an evaluation of the total product control system, such as the emergency shutoff and internal valves equipped for remote closure and automatic shutoff using thermal (fire) actuation, pull away protection where installed, and the optional requirements of Section 6.28.

The philosophy of NFPA 58 is to minimize fires by minimizing the accidental release of propane if an incident should occur. Or put in simple terms, “no fuel, and no fire.”

The manual **does not** address the following:

---

<sup>1</sup> All reference, henceforth, to the “code” in this document should be construed as referring to NFPA 58, 2014 edition.

1. Marine terminals, refrigerated LP-Gas storage and the transportation of LP-gas by either rail tank cars or by cargo tank trucks. Marine terminals are governed by the OSHA Process Safety Management regulations and the US EPA Risk Management Plan regulations; refrigerated storage of LP-gas is a high-volume operation requiring special considerations; and, the transportation of LP-gas is addressed by Title 49 of the Code of Federal Regulations, *Transportation*.<sup>i</sup>
2. Storage of LP-Gas in salt domes and caverns.
3. Installations of ASME LP-gas containers on roofs of buildings. This type of installation, for which a fire safety analysis is required, is excluded from the scope of this manual primarily because of the rarity of such installations in the United States.
4. Cylinder filling operations at a dispensing facility, unless the storage threshold for LP-Gas has been exceeded, requiring an FSA to be prepared.
5. The use of facility employees performing as a “fire brigade.”

The above facilities may be required to comply with other safety analysis requirements.

### **1.3 Need for a FSA Manual**

Neither NFPA 58 nor the “Liquefied Petroleum Gas Code Handbook”<sup>iii</sup> provide detailed guidance on how to prepare or develop a written FSA. Since each industrial plant, bulk plant, or dispensing station presents unique physical and operational characteristics, the fire safety analysis is a tool used to assess the level of fire safety performance that a specific industrial plant, bulk plant or dispensing station can be expected to provide. This FSA will also provide essential information on the facility and its operation to the local authority having jurisdiction (AHJ) and local emergency response agency.

An informal survey was taken of AHJ’s on the fire safety analyses used for existing and new plants in their jurisdictions (conducted by the author) at the time the first edition of this manual was being prepared. It indicated that there was no uniformity either in content, the details of information, or final assessment of the facility in the FSAs submitted. They ranged from a single page submission for a medium size bulk plant to very detailed assessment including risk assessment and management plan for a 30,000 gallon bulk storage facility. Without a guidance manual, potential confusion would almost certainly occur as each AHJ would be required to establish an individual set of criteria that would meet the FSA in their area. Thus, the need in the LP-Gas industry for assistance with the following tasks was clearly established.

- 1) Providing a FSA template that allows for consideration of different size installations
- 2) Establishing a uniform approach and defining common elements
- 3) Developing simplified checklists and an example-based methodology for completing the analysis
- 4) Utilizing technically-based guidance and support

The intent of this FSA manual is to provide an easy-to-use procedure for LP-gas facility owners or operators who are most familiar with the equipment technology and system operations and therefore qualified to complete the document. Knowledge of fire science and engineering

principles is not required for this document to be useable by an owner, operator or an AHJ, because those principles have already been factored into the assessment criteria contained within the FSA.

By utilizing the expertise of industry, engineering and fire service representatives in the development of the material to follow, this manual provides a comprehensive, uniform, objective approach that was designed to provide for the uniform and objective application of FSA requirements by the AHJs. Further, the joint input of the Propane Education & Research Council (PERC), National Propane Gas Association (NPGA), and the National Fire Protection Association (NFPA) provides additional assurance of the manual's depth, credibility and broad-based consensus.

This FSA manual has been developed based on the requirements of NFPA 58, 2014 edition. Using this manual to perform a FSA at a facility constructed to meet the requirements of prior editions of NFPA 58 or other state-specific codes may produce conflicts between actual facility construction and the checklists in this manual. The code or standard in effect at the time of construction of the facility should be used as the source of requirements to perform the FSA. Checklist items contained within this manual can be revised to indicate the appropriate code items required at the time of facility construction.

#### **1.4 LP-Gas Safety Record and Risks**

The LP-Gas industry has a long history of safe operations. With the requirement in the 1976 edition of NFPA 58 to retrofit LP-Gas plants with emergency shutoff valves (ESVs) in transfer lines, the safety of LP-Gas facilities was further improved.

The FSA provided in this manual, in addition to other safety programs currently enacted at any workplace, is intended to reduce or eliminate the risk of fatality or injury to both the plant employees and the public. In an effort to identify the level of risk a propane installation poses to the general public, as well as employees and emergency responders, the U.S. Department of Energy (DOE) instituted a study<sup>iii</sup> in 1981. Accident data from a variety of sources was analyzed, including: the US Department of Transportation hazardous material incident report database, reports of the National Transportation Safety Board, National Fire Protection Association, technical journals and other sources. Data analyzed for the period 1971 through 1979 addressed LP-Gas transportation and product releases from stationary storage facilities. The special focus of the study was the fatalities suffered by employees and the general public. The study concluded that a fatality to the general public as a direct result of an LPG transportation or storage incident involving the loss of product is very small and the risk (expressed in expected number of fatalities per year) is smaller than that from natural phenomena (lightning, tornadoes, objects falling from the sky, etc).

An analysis conducted by the National Fire Protection Association<sup>iv</sup> of LP-Gas fire damage and casualty data during the period between 1980 and 1999 also indicates that the LP-Gas storage facility operations in the US are very safe. The number of reported fires at LP-Gas bulk storage facilities remains small and has fallen since 1980, but substantial variation exists from year to year. During the five-year period from 1994 through 1998, an estimated 49 fires, on average,

were reported per year at LP-Gas bulk storage facilities. These fires caused an annual average of one civilian death, five civilian injuries and \$754,000 in direct property damage. In 1999, an estimated 58 reported fires on these properties caused four civilian injuries and \$722,000 in direct property damage. The 58 fires reported in 1999 accounted for .003% of all fires reported that year.

## **1.5 Organization of the FSA Manual**

The manual has been organized to address the requirements outlined in the 2014 edition of NFPA 58, Sections 6.27 and 6.28.

Chapter 2 discusses the requirements of the 2014 edition of NFPA 58 in regard to product control requirements, and their evolution. The philosophy and the advantages of product control systems are discussed. Also included are the various appurtenances used in a typical LP-Gas facility. More detailed information on the types of valves, their functions and example photographs of various appurtenances are provided in Appendix B. Chapter 3 provides an overview of the FSA process including its principal elements.

The input of data into the FSA procedure begins with Chapter 4. In Chapter 4, basic information about the LP-Gas facility is input into appropriate tables and a decision is made (based on the data provided) as to the extent of the analysis that should be completed. The assessment of conformity with code requirements of the product control requirements for containers and in transfer piping is performed in Chapter 5. To aid this assessment a series of sketches of possible configurations of container appurtenances (satisfying 2014 code requirements) are provided. Note that several section references have been changed from the published edition of the 2014 edition due to the acceptance of Tentative Interim Amendment 14-3, which is reprinted with permission in Appendix C. When necessary, the year when specific equipment was required by the code is also indicated on the sketches to facilitate application of the Manual to facilities constructed to the requirements in previous editions of NFPA 58. The analysis of the local conditions of hazard is presented in Chapter 6, followed by the assessment in Chapter 7 of the hazard exposure to off-site properties and persons. Also, the potential exposure to LP-Gas installations from off-site activities is covered in Chapter 7.

The evaluation of the capabilities of the local emergency responder (usually the fire department) and the availability of water to fight in-plant fires and exposures are presented in Chapter 8. Summary of evaluations and actions that may need to be initiated for proposed LP-Gas facilities are presented in Chapter 9. The use of this manual in preparing a written FSA for a LP-Gas facility is demonstrated with examples of four different generic cases. Several different sizes of facilities are considered.

A set of blank forms required to perform a FSA is provided in Appendix A. The results of calculating the hazard distances for a set of credible LP-gas release scenarios are provided in Appendix B. Also provided in Appendix B are the thermodynamic properties of propane and the values of other parameters used in calculating the hazard distances.

---

<sup>i</sup> U. S. Code of Federal Regulations, Title 49, Transportation

<sup>ii</sup> Liquefied Petroleum Gas Handbook, Beach, 2014, NFPA, Quincy MA

<sup>iii</sup> LPG Land Transportation and Storage Safety, Department of Energy report No. DOE/EV/06020-TS 9/18/81"

<sup>iv</sup> Fires at LP-Gas Bulk Storage Plants Statistical Analysis, NFPA, 2003, Quincy, MA

## CHAPTER 2

### LP-Gas Storage Container Safety Features

The fundamental premise on which the requirements for LP-Gas facility safety specified in several recent editions of NFPA 58 is based is the following:

**If product release can be either controlled or eliminated, safety is effectively addressed.**

A product release creates the potential for the occurrence of a fire. Therefore, the focus of both NFPA 58 and the Fire Safety Analysis Manual is on the need to design systems (incorporating product controls) to ensure, to the extent possible with current technology and procedures, the elimination of the accidental release of LP-gas from storage or during transfer operations.

#### **2.1 A Historical Perspective**

In the late 1960's and the early 1970's there were a number of fires and BLEVEs (Boiling Liquid Expanding Vapor Explosions) of propane and other liquefied petroleum gases resulting from derailments of railcars carrying propane and other flammable liquefied gases. These incidents involved fire fighter fatalities and highlighted the need for safety improvements. As a result, the U. S. Department of Transportation (DOT) implemented new regulations for the tank cars used to transport propane and other liquefied flammable gases, and made them mandatory and retroactive in 1980. These improvements included:

- Head shields to reinforce the pressure vessel on the railcar
- “Shelf” couplers to reduce the potential for railcars to be uncoupled during a derailment
- Thermal protection to reduce the potential for the tank to experience a rise in temperature due to flame impingement

Since these improvements in rail car safety were made in the 1980's, there have been no fire fighter fatalities from any railroad tank car BLEVEs and the number of these incidents has been greatly reduced, to the authors' knowledge.

In 1973, product control requirements to prevent the uncontrolled release of LP-gas from storage containers consisted primarily of manually operated valves, backflow check valves and excess-flow check valves.

On July 3, 1973 a propane incident occurred in Kingman, Arizona involving a propane fire at a propane tank car unloading area in a propane bulk storage plant. Though the plant's equipment conformed to the requirements of NFPA 58 and other safety standards for flammable materials at that time, the incident resulted in the death of several fire fighters and one plant employee.

A direct result of this incident (and others that occurred at approximately the same time) was the addition of a new fire protection requirement in the 1976 edition of NFPA 58. The requirement stated that planning “for the effective measures for control of inadvertent LP-Gas release or fire” shall be done and coordinated with local emergency responders. In addition, the primary consideration of a fire safety analysis at that time was the use of water as a suppressing agent to control fires. The requirements today are very similar to those original requirements except in two areas.

- As of the 2001 edition, fire safety analyses are required to be written;
- The primary consideration in performing such an analysis has changed from the emphasis of using water for fire control to the emphasis of avoiding product release altogether using technology and training.

This modern approach takes advantage of the inherent safety present in a controlled environment such as a bulk plant, as well as the safety features of the most current product control hardware.

In early editions of NFPA 58, the primary consideration of water as the means to control a fire was based on the fact that at that time, there were few reliable ways to stop the flow of LP-gas after failures in the system and the need to apply water quickly to storage containers being impinged by flames was important.

Another significant change in the 1976 edition of NFPA 58 was the requirement for including an emergency shutoff valve (ESV) in the transfer lines used between stationary storage containers of over 4,000 gallons capacity and cargo tank vehicles. This revision was intended to prevent product release from storage containers in the event of a vehicle pulling away with its hoses still connected. All existing plants were required to comply with this requirement by the end of 1980. Since this retrofit program was completed, there has not been, to the knowledge of the authors, a pull-away accident involving an ESV installation that resulted in serious consequences.

The 1980’s enjoyed a reduced number of propane incidents in the U. S., and the next major product control enhancement was the revision to introduce an optional requirement for internal tank valves in containers over 2,000 gallons in the 1992 edition of NFPA 58. These tank valve requirements included:

**Vapor and Liquid Withdrawal Openings in Tanks**

1. Positive shutoff valve in line with excess flow valve installed in the tank, or
2. Internal valve with integral excess flow shutoff capability

**Vapor and Liquid Inlet Openings in Tanks**

1. Positive shutoff valve in combination with either an excess flow valve or backflow check valve installed in the tank, or
2. Internal valve with integral excess flow valve, or
3. Internal valve with remote means of closure

These revisions were made to enhance the operational features of product control hardware. Internal valves are capable of being closed from a remote location (using a cable, pneumatic, or hydraulic device) and by thermal activation, which is accomplished using an element that melts when it is subjected to fairly moderate temperatures (in the 200°F - 250° F range).

The 2001 edition of NFPA 58 was further revised to require internal valves for liquid connections to containers over 4,000 gallons, with remote and thermal shutoff activation. This change was the result of the Committee desiring improved safety performance with this advanced hardware, due to the following incidents:

- **Sanford, NC.** A hose separation resulted in the loss of the contents of a transport vehicle (9700 gallons water capacity). The contents within the storage containers were also lost because of a failed check valve.
- **Albert City, Iowa.** An exposed liquid pipe installed in violation of the code between an 18,000 gallon water capacity storage container and a vaporizer was broken when a recreational vehicle accidentally drove over it. The leaking gas found a source of ignition and impinged on the container, resulting in a BLEVE.
- **Truth or Consequences, NM.** A small, parked truck rolled into a propane bulk storage plant, breaking plant piping. The resulting fire caused the failure of several cylinders.

These improvements in product control are considered critically important, and in addition to requiring them for all new installations after 2001, the requirements were made retroactive to all existing installations, allowing 10 years for the conversion. All existing containers over 4,000 gallons water capacity will be retrofit with an internal valve or similar protection on all liquid connections. Alternatively, the use of an emergency shutoff valve (ESV) as close to the container as practical is also allowed, in recognition that some containers cannot accommodate an internal valve without extensive modification. The ESV has the same remote and thermal activation closing features as an internal valve.

## **2.2 Current LP-Gas Storage Container Safety Features**

As of the 2001 edition, NFPA 58 requirements for product release control include the provision for a number of different types of valves or appurtenances in the product storage containers, transfer piping network and at liquid transfer facility locations. Generally, code requirements for product control appurtenances on containers used in industrial plants and bulk plants, as well as dispensing stations, are more stringent than for residential and commercial use containers.

In the 2014 edition of NFPA 58, changes to the definitions of “Bulk Plant” and “Industrial Plant” clarified the intent of the NFPA Technical Committee on Liquefied Petroleum Gases by stating that each of those types of facilities utilize only containers greater than 4,000 gallons water capacity. Therefore, modifications were made to Chapter 5 of this manual to remove references to containers between 2,000 and 4,000 gallons water capacity. The manual does retain information on containers less than 4,000 gallons water capacity due to

the fact that some dispensing stations may be utilizing more than one container less than 4,000 gallons, but with an aggregate capacity greater than 4,000 gallons.

Unless product is being transferred, product control valves are normally in the closed position. However, some of the installations require an automatic shutoff feature when either a fire (or heat) is sensed or when other abnormal conditions occur. The product control valves include the following:

**Positive shutoff valve:** A shutoff valve that, in the closed position, does not allow the flow of product in either direction. [NFPA 58, 3.3.75.7]

**Backflow check valve:** This valve allows flow in one direction only and is used to allow a container to be filled while preventing product from flowing out of the container.

**Excess-flow valve:** A valve designed to close when the liquid or vapor passing through it exceeds a prescribed flow rate. [NFPA 58, 3.3.75.3]

**Internal valve:** A container primary shutoff valve that can be closed remotely, which incorporates an internal excess flow valve with the seat and seat disc located within the container so that they remain in place should external damage occur to the valve. [NFPA 58, 3.3.75.6]

**Emergency shutoff valve:** A shutoff valve incorporating thermal and manual means of closing that also provides for a remote means of closing. [NFPA 58, 3.3.75.2]

**Hydrostatic pressure relief valve:** A type of relief valve that is set to open and relieve pressure in a liquid hose or pipe segment between two shutoff valves when the pressure exceeds the setting of the valve.

**Container pressure relief valve:** A type of pressure relief device designed to open and then close to prevent excess internal fluid pressure in a container without releasing the entire contents of the container. The valve is located in the vapor space of the container.

Bulk storage installations incorporate several product release control appurtenances. This fire safety analysis manual outlines alternative schematics for the various facilities covered (4,000 gallons or less and greater than 4,000 gallons water capacity).

# CHAPTER 3

## Principal Elements of the Fire Safety Analysis

The principal elements of the Fire Safety Analysis (FSA) required by NFPA 58 (in §6.27, and container protection requirements in §6.27.3) are described in this chapter. This manual for performing the FSA addresses the following LP-Gas facility-related items:

- 1 Effectiveness of Product Control measures
- 2 Local conditions of hazard within the container site, including congestion within the site
- 3 Exposure to off-site properties and populations and the impact of neighboring industrial activity on the facility
- 4 Effectiveness of the local Fire Department that may respond to an emergency within the facility
- 5 Requirements for and availability of adequate water supply
- 6 Full compliance with Code requirements for existing LP-Gas facilities and corrective actions to be implemented for a proposed facility to address any deficiencies

The details of how each of the above items is evaluated in performing the FSA are indicated in Chapter 4 through Chapter 9. Shown below is a brief review of the various steps involved in conducting the FSA.

### **3.1 Important Steps in Conducting the Analysis**

The development of a Fire Safety Analysis (FSA) involves a number of important steps. These steps are indicated in Table 3.1. Also shown in Table 3.1 are the chapters in this manual where the referenced analysis steps are discussed in detail.

Each set of FSA requirements is presented in one or more tables and fill-in forms. The tables provide either factual information or calculated results; the user obtains information from the tables for further analyses. The fill-in forms specify NFPA 58 requirements or other assessment parameters, and provide two columns, one with a “Yes” column heading and the other with a “No” heading. In some cases either schematic or pictorial representations are provided to clarify a requirement. The fill-in forms require some information input from the user, either checking a “Yes” column or a “No” column or writing a numerical value. Also provided are notes under each table or fill-in form, which explains conditions, if any, associated with the table or the form or how a calculation is performed for entering data into the form.

Appropriate explanations are provided in the text either preceding a form or after the form, if any action is necessary depending upon the values/contents in the forms. A blank copy of each form presented in Chapter 4 through Chapter 9 is provided in Appendix A. These can be reproduced and used for any number of LP-Gas facilities.

The FSA for a LP-Gas facility is conducted by systematically completing the forms in Chapter 4 through Chapter 9. The person completing the FSA must indicate a “Yes” or “No” in the appropriate column for each requirement, depending upon whether the LP-Gas facility fulfills the specific requirement. Any items, which may need to be undertaken to correct a deficiency in a proposed (as opposed to existing) LP-Gas facility are referred to in Chapter 9.

Once the FSA is complete, the forms together with information about the facility, can be filed to satisfy the “written” requirement of NFPA 58, §6.27.3.2 & 6.27.3.3. Any emergency planning for the facility is required to be coordinated with the local fire department or equivalent responding authority (§ 6.27.2.1).

### **3.2 Completing the FSA**

Chapters 4 through 9 provide a framework with which the Fire Safety Analysis can be conducted to satisfy the requirements of NFPA 58. It is important to note the following in performing the analysis using the tables, fill-in forms and steps indicated in the following chapters.

- 1 All references to the “Code” in this manual are to the 2014 edition of the NFPA 58 “Liquefied Petroleum Gas Code.”
- 2 If a LP-Gas facility was built to satisfy the requirements of an edition of NFPA 58 earlier than the 2014 edition, then you may obtain a copy of the appropriate edition of the Fire Safety Analysis Manual and use that resource for your evaluation. If you must use this manual and an appurtenance or other requirement is specified in one or more of the forms in this manual (developed based on the 2014 edition), and this requirement was not in the edition to which the facility was built, then it is recommended that the “Yes” and “No” column corresponding to the particular appurtenance or requirement be left blank or marked “NA,” to signify the requirement is not applicable to the facility in question.
- 3 If the facility for which the analysis is being performed was constructed to satisfy the requirements of a previous edition of NFPA 58, it must still comply with all requirements that have been made applicable retroactively in later editions of the code, through the 2014 edition. Such retroactive provisions are indicated where they are applicable.

**Table 3.1**  
**Description of the Various Steps in Performing the FSA**

<b>Step #</b>	<b>FSA Steps</b>	<b>Chapter where described</b>
1	Gather data on the volume of LP-Gas stored and other information pertinent to the facility.	Chapter 4
2	Perform simple calculations and determine whether the facility is subject to the requirements for developing an FSA.	
3	Evaluate the product control appurtenances and other safety features of the facility relative to the requirements of the NFPA 58 code.	Chapter 5
4	Assess the appurtenance requirements for containers of different capacities and compare them to the actual installation.	
5	Evaluate the requirements for valves on transfer piping and compare them to the valves provided in the facility.	
6	Assess conformance to the code of a Redundant and Fail-Safe Product Control System, if such a system is provided in the facility.	
7	Evaluate the code conformance of the Low Emission Transfer Equipment if installed in the facility.	
8	Analyze the protection measures against local conditions of hazard. That is, assess whether all requirements of the code for the physical protection of containers and transfer piping are implemented.	Chapter 6
9	Analyze the code requirements for the control of ignition sources and whether these requirements are complied with.	
10	Assess conformance to the code requirements for separation distances between (i) containers of different sizes and property lines and, (ii) LP-Gas transfer points and other exposures.	
11	Evaluate conformance to the code requirements for Special Protection Systems, if they are provided on containers in the facility.	
12	Evaluate the potential hazards to off-site populations and property from propane releases in the facility. This step includes selecting credible LP-Gas release scenarios and assessing the distance (and area) over which the hazard exists.	Chapter 7
13	Assess whether any off-site populations, especially people in institutional occupancies, are potentially subject to the LP-Gas release hazards	
14	Evaluate whether there exists a hazard from other industrial operations around the LP-Gas facility	
15	Evaluate the effectiveness of the local Fire Department, including the availability and capability of response personnel, training level, equipment and response time to an emergency in the facility.	
16	Evaluate the amount of water needed to cool containers exposed to a fire and the adequacy of the facility (or locally available) water supply.	Chapter 8
17	For a proposed facility, develop corrective actions to address deficiencies found.	Chapter 9 (Only applicable for proposed facilities)
18	Assess, based on specific criteria, the need to provide Redundant and Fail-Safe Product Control Systems.	
19	Assess, based on specific criteria, the need to provide Low Emission Transfer Systems.	
20	Assess when Special Protection Systems are needed	
21	Evaluate alternative approaches to using water in a special protection system	

# CHAPTER 4

## Facility Information

In this chapter basic information on the LP-Gas facility is recorded and a decision is made on whether the facility is required to have a completed Fire Safety Analysis (FSA) performed. If it is determined that a FSA is required, additional information on the facility is recorded.

### 4.1 Initial Data for the LP-Gas Facility

Complete Form 4.1 to provide basic information on the facility.

#### Form 4.1 Initial Data on the LP-Gas Facility

A	B	C
Item #	Information Item	Data
1	Name of the LP-Gas Facility Owner or Operator	
2	Contact Name:	
3	Contact Telephone & Fax Numbers	
4	Contact Email Address	
5	Mailing Address	Street 1:
		Street 2:
		City, State, Zip:

### 4.2 Facility Storage Capacity and Other Details

Complete Form 4.2. Multiply Column B by its corresponding entry in Column C, write the answer in the corresponding cell in Column D, then sum all the entries in Column D and write it in Row 2, Column D. This number is the “Aggregate Water Capacity” of the facility.

**Form 4.2**  
**Facility Storage Capacity** <sup>1,2,3</sup>

A	B	C	D
Item #	Individual Container Water Capacity (w.c.) (gallons)	Number of containers	Total Water Capacity (w.c.) of each container size (gallons)
1	500		
	1,000		
	2,000		
	4,000		
	10,000		
	18,000		
	30,000		
	60,000		
	Other:		
	Other:		
Other:			
Other:			
2	Aggregate Water Capacity <sup>4</sup>		

- Notes:**
- (1) Column D = Column B x Column C.
  - (2) Parked bobtails, transports and tank cars should not be considered for aggregate capacity calculations.
  - (3) Do not consider containers that are not connected for use.
  - (4) For the purpose of this manual, "Aggregate Water Capacity" means any group of single ASME storage containers separated from each other by distances less than those stated in the aboveground containers column of Table 6.3.1.1.

**If the aggregate water capacity of the LP-Gas facility is less than or equal to 4,000 gallon (w.c.), no further assessment is required.**

**YOU CAN STOP HERE.**

**If the aggregate water capacity of the facility is greater than 4,000 gallons, continue the analysis.**

**4.3 Additional Facility Information**

Complete Form 4.3 below and record additional information on the facility.

**Complete also the remainder of Fire Safety Analysis indicated in Chapter 5 through Chapter 8 (plus Chapter 9 for proposed facilities).**

**Form 4.3**  
**Additional Information on the LP-Gas Facility**

Existing Facility built to NFPA 58 Edition \_\_\_\_\_  Proposed Facility

a) Name of the Facility (if applicable) \_\_\_\_\_

b) Type of LP-Gas Facility       Dispensing Station       Industrial Plant       Bulk Plant

c) Facility is located in       Rural Area       Suburban Area       City Commercial Zone  
 City Industrial Zone

d) Facility neighbors<sup>§</sup>:       Agri. fields       Commercial Bldgs.       Flammable Liquids Storage  
(Check all that apply)       Industrial Activity (metal fabrication, cutting and welding, etc)  
 Manufacturing       Others (explain) \_\_\_\_\_

e) Geographic Location of Facility/Address: \_\_\_\_\_  
\_\_\_\_\_

f) Landmarks, if any: \_\_\_\_\_  
\_\_\_\_\_

g) LP-Gas liquid supply by:       Bobtail       Truck Transport       Rail Tank Car  
(Check all that apply)       Pipeline

h) LP-Gas Distribution by:       Bobtail       Truck Transport       Vapor Piping  
(Check all that apply)       Liquid Piping       Dispensing or Vehicle Liquid fueling

i) Number of Vehicle Entrances:       One       Two       More than two

j) Type of Access Roads to the Facility       Rural       City or Town       Highway  
(One check per line) Entrance 1       Dirt road       Gravel road       Paved  
(One check per line) Entrance 2       Dirt road       Gravel road       Paved

k) Staff presence       Not staffed       Only during transfer operations  
 Staffed always (24/7)       Only during business hours  
 Other (Explain) \_\_\_\_\_

l) Location and distances to Assembly, Educational or Institutional Occupancies surrounding the facility, if any, within 250 ft from the facility boundary in the direction of the assets.  
\_\_\_\_\_  
\_\_\_\_\_

m) Overview plot plan of the facility attached?       Yes       No

§ All properties either abutting the LP-Gas facility or within 250 feet of the container or transfer point nearest to facility boundary.

# CHAPTER 5

## Analysis of Product Control Measures In Containers and Transfer Piping

### 5.1 Product Control Measures in Containers

NFPA 58 requires the installation of several product control safety devices both on containers and in transfer piping to minimize the accidental release of LP-Gas, either liquid or vapor. The requirements for product control equipment depend on the following:

- The size of individual containers,
- Whether the containers in a facility are individually filled or filled through a common liquid manifold,
- Whether the product is transferred from the storage container as a liquid or vapor (or both).

A facility may have LP-Gas containers of different sizes; it is therefore necessary to evaluate compliance with the code requirements on a container-by-container basis as well as on a facility basis.

In this chapter, the appurtenance requirements of the code are listed for LP-Gas containers of different sizes. A series of forms are provided which indicate the code-required product control hardware for container and facility piping. The forms also provide space to record the product control equipment actually installed on the containers as well as transfer piping at the facility. These forms must be completed as a part of this Fire Safety Analysis.

**Note: Section numbers and table numbers have been changed significantly as a result of Tentative Interim Amendment TIA 14-3, shown in Appendix C.**

Complete Forms 5.1 or 5.2 depending upon the size of the individual containers in the facility. Then, perform an analysis of the product control appurtenances for each container located in the facility.

**Table 5.1  
Container Size-Dependent Evaluations**

If the LP-Gas facility contains individual containers in the volume range (gallons w.c.)			Perform the analysis specified in Section
Greater than	And Less than or equal to		
0	4,000		5.1.1
4,000	-		5.1.2

### **5.1.1 Individual Containers of Water Capacity less than or equal to 4,000 gallons**

Containers of 4,000 gallons water capacity (w.c.) or less can be configured with product control appurtenances in a number of different ways. These are schematically illustrated in Figures 5-1A through Figure 5-1E. *Note: Container appurtenances shown are illustrative of product control equipment only. See NFPA 58 for all container appurtenances required. Illustrations are not intended to be used for system design purposes*

#### **Complete the following steps using the schematics in Figure 5-1A through Figure 5-1E**

- 1 Select the first container at the facility, which has a water capacity of 4,000 gallons or less. Enter this as container number 1 in Column A of Form 5.1, below.
- 2 Review each of the service configurations given in Figure 5-1A through Figure 5-1E. Select the schematic that most closely represents the configuration in the facility for this container. Enter the figure number of the configuration selected for this container in Column B.
- 3 Count the total number of “Yes” shown in this configuration. This represents the number of required appurtenances for the specific configuration. Enter this number in column C of Form 5.1.
- 4 Check “Yes” under each appurtenance that is actually installed on the container. If the appurtenance is not provided, then check “No.”
- 5 Count the number of boxes checked “Yes.” Enter this number in Column D of Form 5.1.
- 6 Repeat steps 1 through 5 for each container of 4,000 gallons water capacity or less at the facility.

## Form 5.1


### Compliance with Code Requirements for Appurtenances on Containers of 4,000 Gallons Water Capacity or Less

A	B	C	D	E
Container #	Service Configuration Sub Figure (in Figure 5-1)	Number of Product Control Appurtenances		NFPA 58 Section Reference (2014 edition)
		Required by NFPA 58 (applicable edition)	Installed on the Container	
1				5.7.4.1 Table 5.7.4.1(B) and 5.7.4.4
2				
3				
4				
5				
6				


**If, in Form 5.1, any one of the numbers in column D is less than the number in Column C of the corresponding row, then these items must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

**Figure 5-1**  
**Schematic Representation of the NFPA 58 Requirements for Product Control**  
**Appurtenances on Containers of Water Capacity Less Than or**  
**Equal to 4,000 Gallons, with Different Service Configurations**

*(Note: Container appurtenances shown are illustrative of product control equipment only. See NFPA 58 for all container appurtenances required. Illustrations are not intended to be used for system design purposes)*

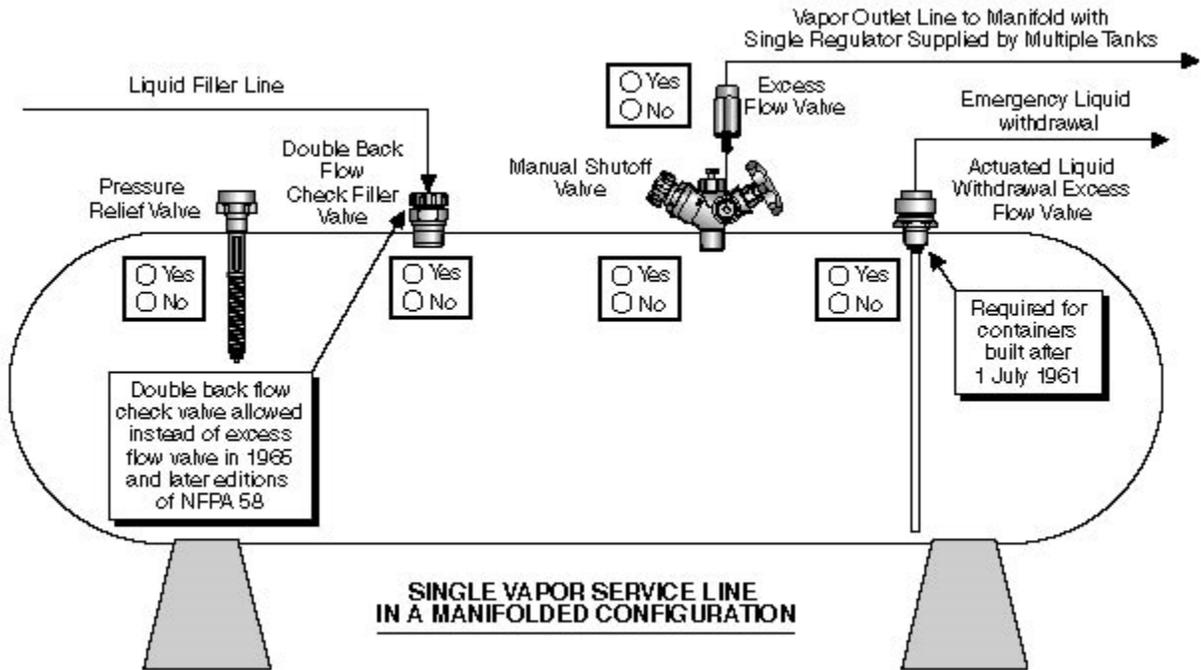


**Figure 5-1A: Single Vapor Service Line in a Manifolded Configuration**

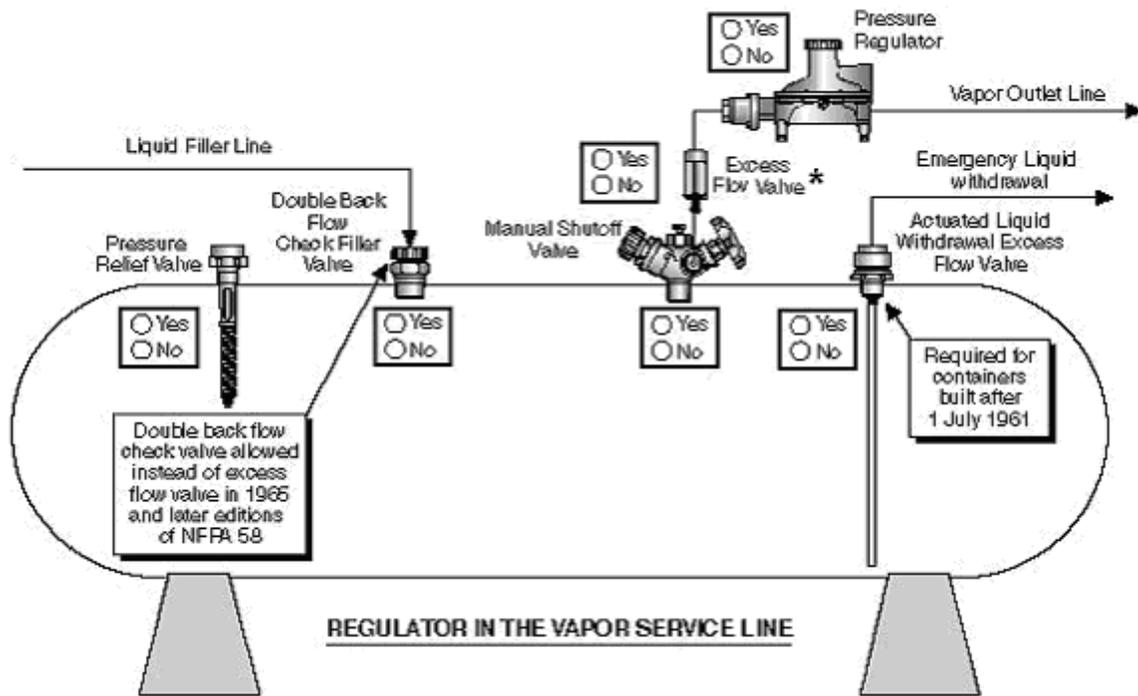


**Figure 5-1B: Regulator in the Vapor Service Line**

- \* Excess-flow protection is not required for manual shutoff valves for vapor service where an approved regulator is directly attached or attached with a flexible connector (“pig tail”) to the outlet of the manual shutoff valve for vapor service, and the controlling orifice between the container contents and the shutoff valve outlet does not exceed 5/16 inch (8 mm) in diameter (5.7.4.1 (B)(8), NFPA 58).

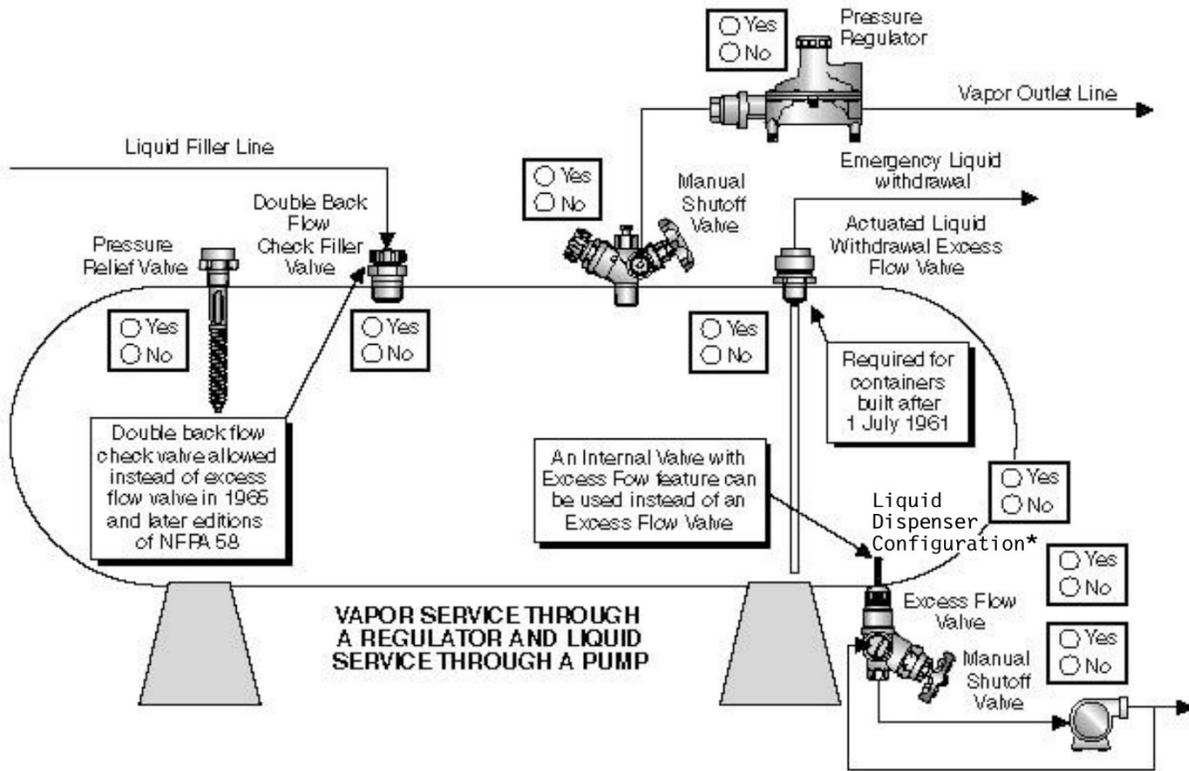


\*For liquid dispenser configuration, see 6.25.3.8.

**Figure 5-1C: Container with Both Liquid and Vapor Service, Regulator in the Vapor Service Line.**

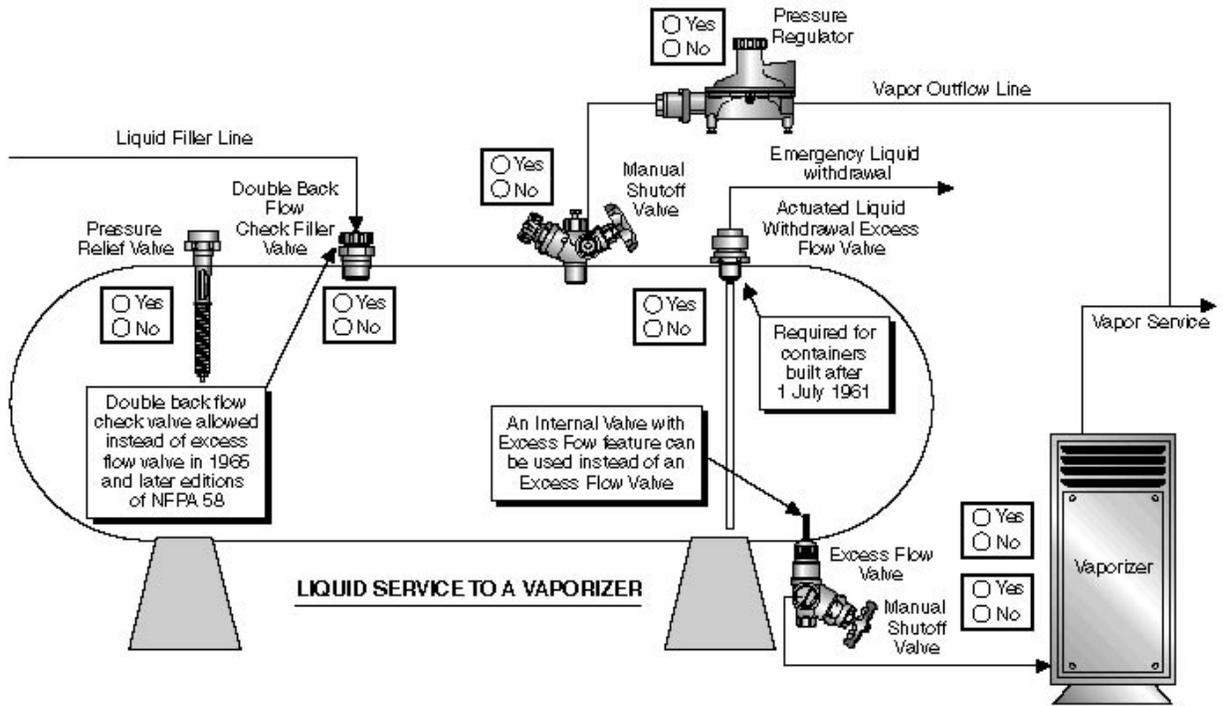

**Figure 5-1D: Container Feeding Liquid to a Vaporizer.**

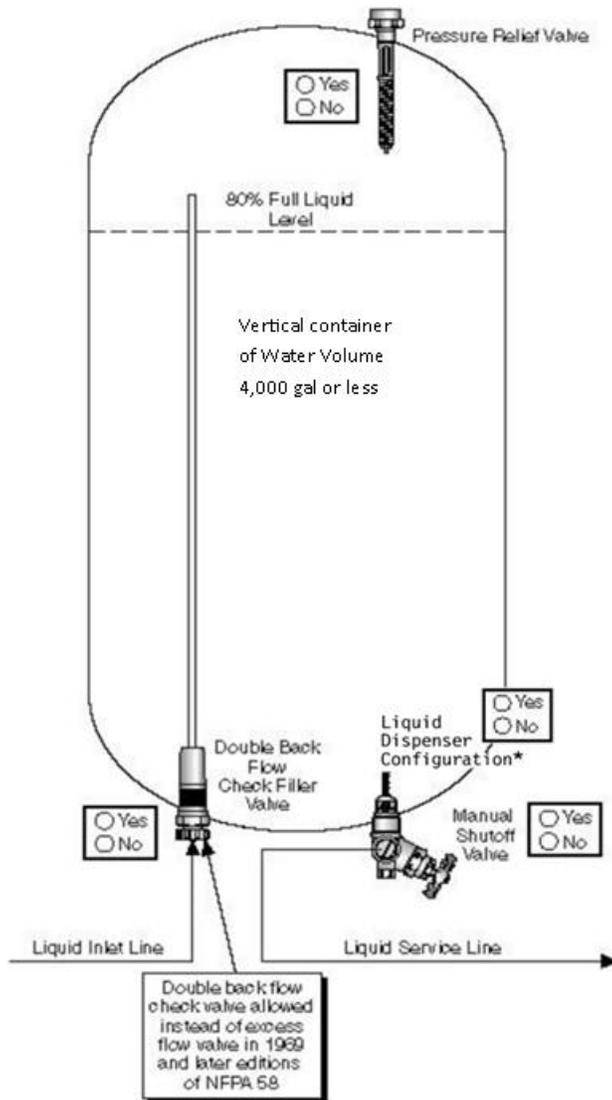

\*For liquid dispenser configuration, see 6.25.3.8.

**Figure 5-1E: Vertical Container for Liquid Service, 4,000 Gallon w.c. or Less.**

### **5.1.2 Individual Containers Having a Water Capacity Greater than 4,000 Gallons**

The compliance with the code requirements for appurtenances in this container size range must be evaluated for LP-Gas flow both into the container (vapor and liquid) and out of the container (vapor and liquid). In addition, note that there are retrofit requirements for existing containers without internal valves in liquid service that were to be completed by July 1, 2011. Several different appurtenance service configurations meet these requirements. These are indicated in Form 5.3. *Note: Container appurtenances shown are illustrative of product control equipment only. See NFPA 58 for all container appurtenances required. Illustrations are not intended to be used for system design purposes.*

#### **Enter the information in Form 5.2 by following the steps indicated below**

- 1 Select the first container in the facility having a water capacity greater than 4,000 gallons. Enter this as container number 1 in Column A of Form 5.2 below.
- 2 Complete each of the rows identified as the vapor inlet, vapor outlet, liquid inlet and liquid outlet service for this container.
- 3 Select the appurtenance configuration for vapor service which most closely corresponds to the design used in the facility. Figure 5-2 shows different vapor inlet configurations. Enter in column D the configuration number that corresponds to the design used in the facility.
- 4 Count all “Yes” in the schematic sketch corresponding to this configuration and which provide for vapor inlet into the container. This is the number of required appurtenances that should be provided according to the code. Enter this number in column E of the row corresponding to “Vapor Inlet.”
- 5 Check “Yes” corresponding to each appurtenance that is installed on this container. If the appurtenance is not provided, then check “No”. Count the total number of boxes with installed appurtenance marked “Yes” in the facility. Record this number in column F of the same row.
- 6 Repeat steps 3, 4 and 5 for each vapor outlet configuration (using Figure 5-3), liquid inlet configuration (using Figure 5-6) and liquid outlet configuration (using Figure 5-7).
- 7 Repeat steps 1 through 6 for each container of water capacity greater than 4,000 gallons located at the facility.


## Form 5.2

### Compliance with Code Requirements for Appurtenances on Containers Having a Water Capacity Greater Than 4,000 Gallons

A	B	C	D	E	F	G
<b>Container #</b>	<b>LP-Gas inlet to and outlet from the container**</b>		<b>Enter Configuration Number</b>	<b>Total Number of Product Control Appurtenances</b>		<b>NFPA 58 Section Reference (2014 edition)</b>
				<b>Required by NFPA 58 (applicable edition)</b>	<b>Installed on the container</b>	
1	<b>Vapor</b>	Inlet	5-2			5.7.4.2, Table 5.7.4.2 and 5.7.4.3
		Outlet	5-3			
	<b>Liquid</b>	Inlet	5-6			
		Outlet	5-7			
2	<b>Vapor</b>	Inlet	5-2			
		Outlet	5-3			
	<b>Liquid</b>	Inlet	5-6			
		Outlet	5-7			
3	<b>Vapor</b>	Inlet	5-2			
		Outlet	5-3			
	<b>Liquid</b>	Inlet	5-6			
		Outlet	5-7			
4	<b>Vapor</b>	Inlet	5-2			
		Outlet	5-3			
	<b>Liquid</b>	Inlet	5-6			
		Outlet	5-7			


\*\* If the container does not provide an opening for the specific function listed, enter 0 (zero) in columns E and F corresponding to that row.

**If in Form 5.2 any one of the numbers in column F is less than the number in Column E of the corresponding row, these items must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

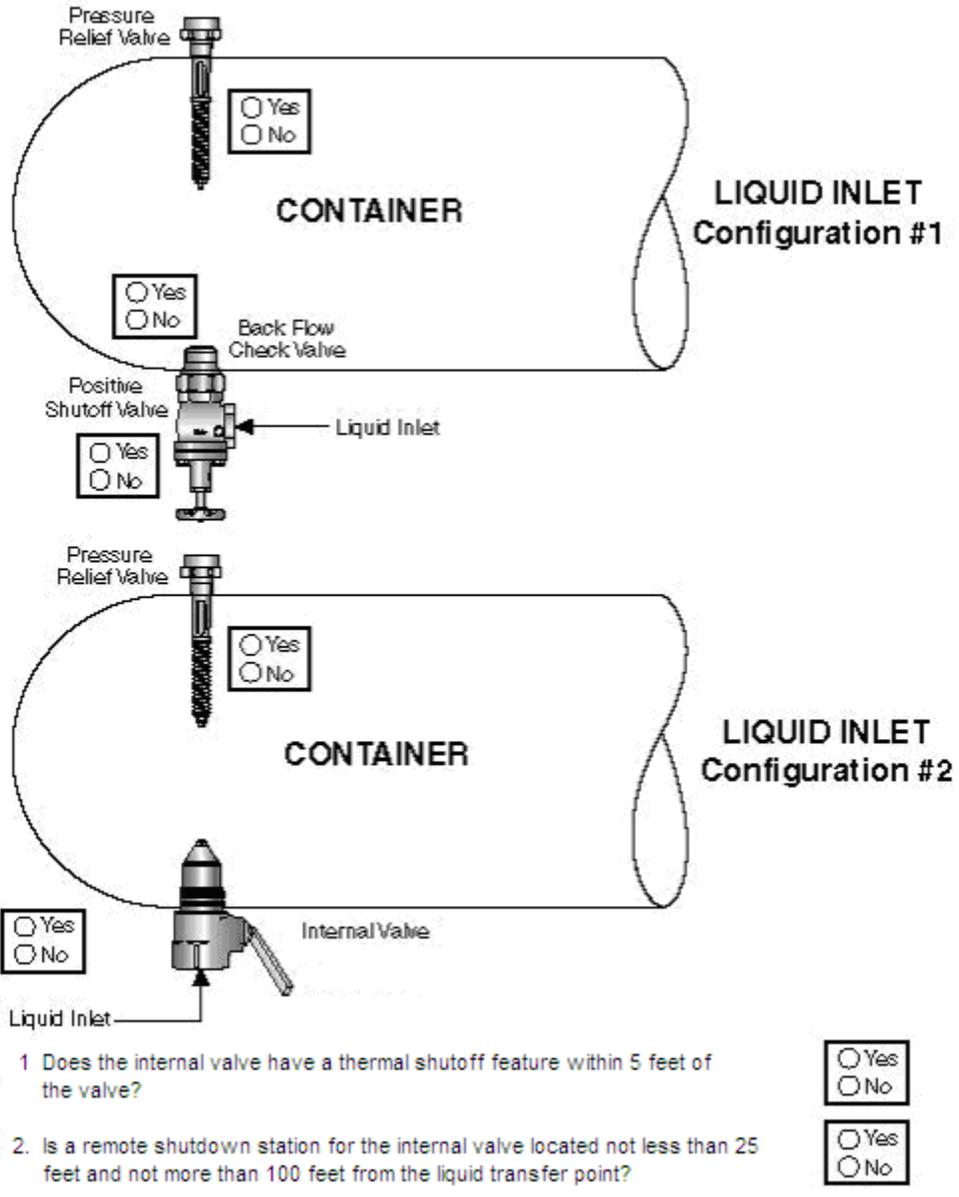


**Figure 5-6A Liquid Inlet Valves on Containers With Water Capacity Greater Than 4,000 Gallons in New Installations**

(NOTE: Prior to July 1, 2011 existing installations may utilize Configurations 3, 4 or 5 of Fig 5-6B, or either configuration in Figure 5-6A. After July 1, 2011, installations must comply with Configurations 4 or 5 below, or Configuration 1 or 2 in Figure 5-6A.)

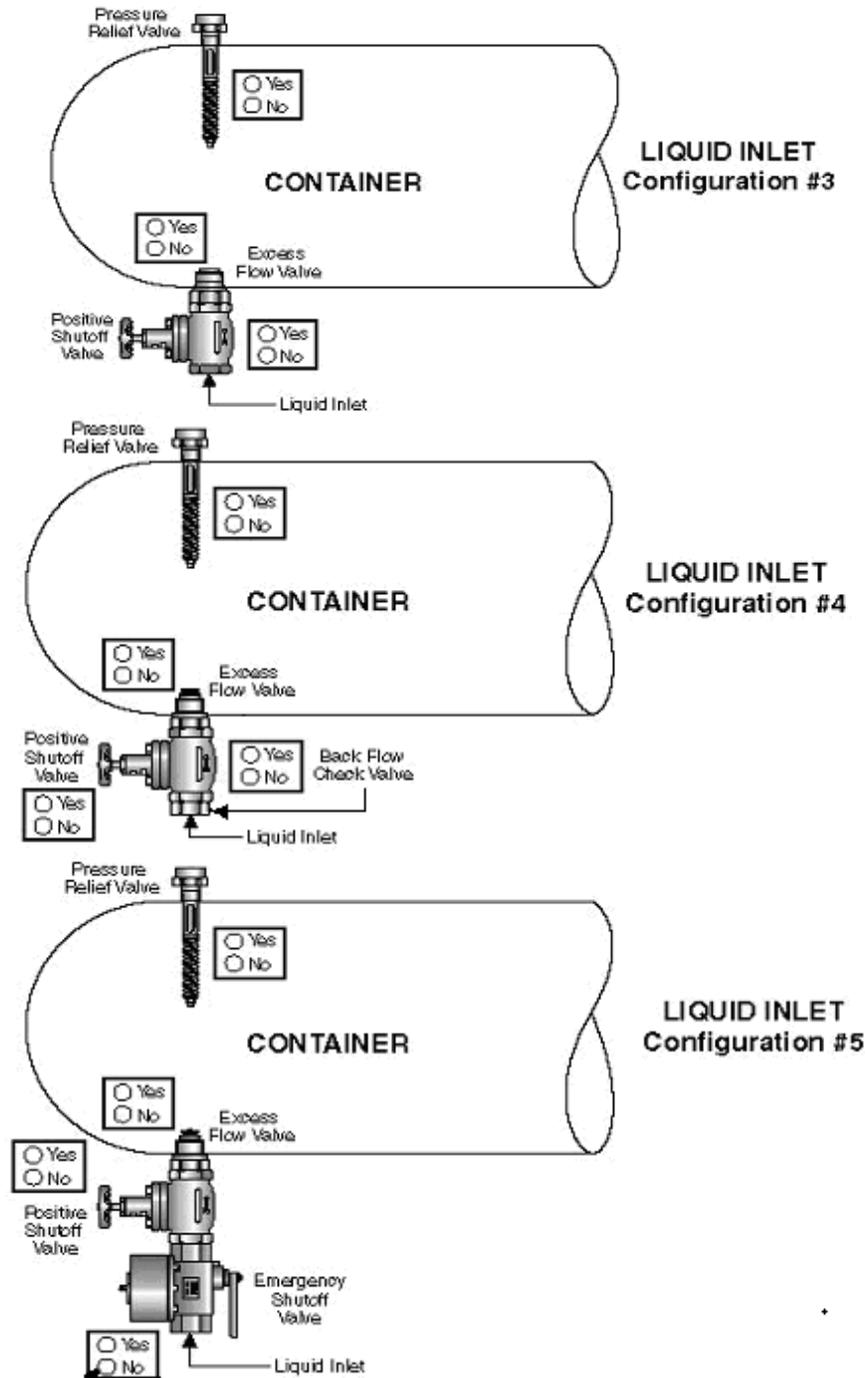


**Note:** The emergency shutoff valve in configuration #5 must be equipped for remote closure. This valve must be installed in the line upstream as close as practical to the positive shutoff valve/excess-flow valve combination.

**Figure 5-6B: Liquid Inlet Valves on Containers With Water Capacity Greater Than 4,000 Gallons in Existing Installations**

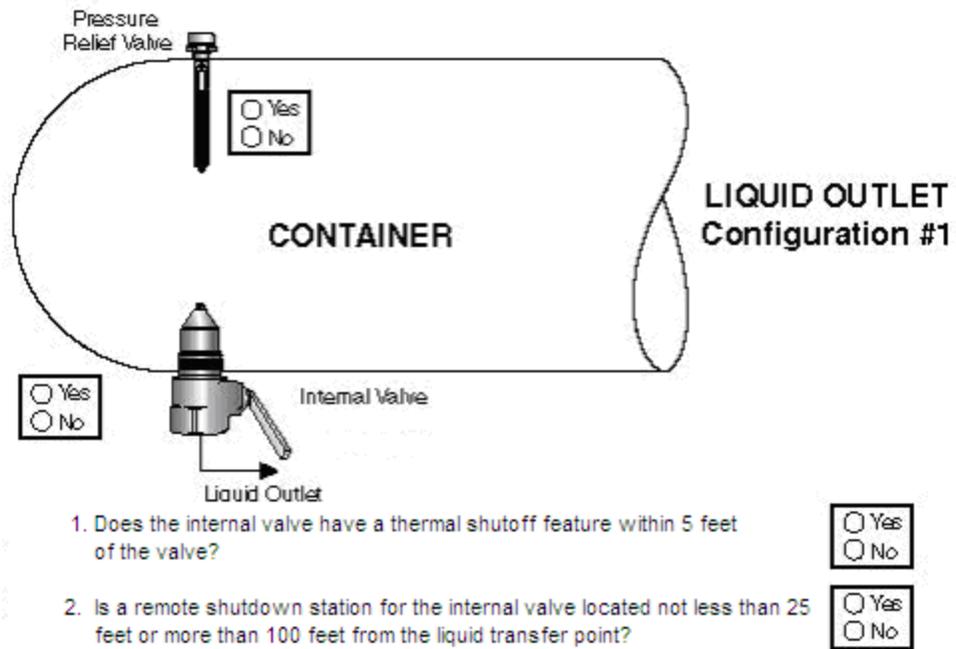

**Figure 5-7A: Liquid Outlet Valves on Containers with Water Capacity Greater Than 4,000 Gallons in New Installations**

**(NOTE: Prior to July 1, 2011, existing installations may utilize Configurations 2 or 3 of Fig 5-7B or Configuration 1 in Figure 5-7A. After July 1, 2011, installations must comply with Configuration 3 in Figure 5-7B or Configuration 1 in Fig. 5-7A).**

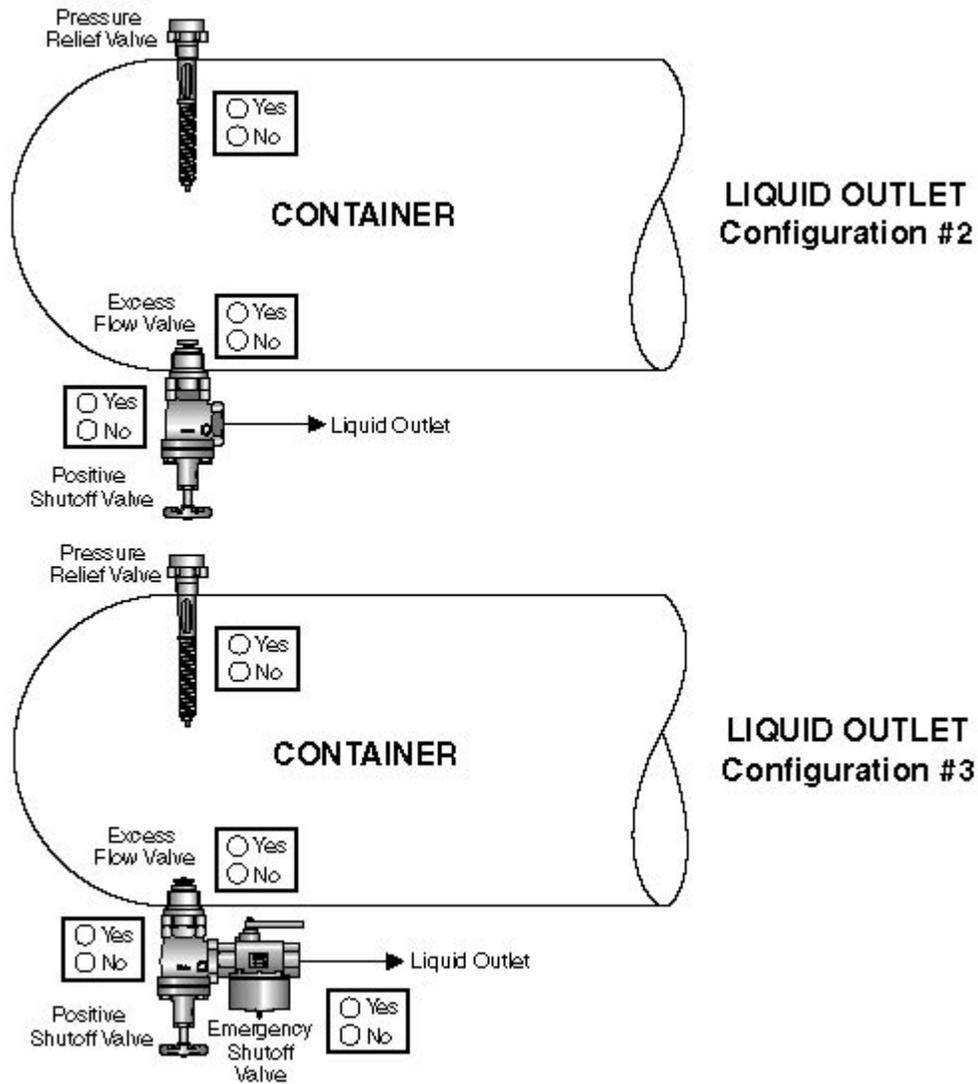

**Note:** The emergency shutoff valve in configuration # 3 must be equipped for remote closure. This valve must be installed in the line downstream, as close as practical to the positive shutoff valve/excess- flow valve combination.

**Figure 5-7B: Liquid Outlet Valves on Containers with Water Capacity Greater Than 4,000 Gallons in Existing Installations**

## 5.2 Product Control Measures in Transfer Piping

### 5.2.1 Manifolded and Remotely Filled Containers

The containers in some LP-Gas facilities, especially in bulk plants, may be remotely filled with an inlet manifold connected to one or more containers. The vapor withdrawal or liquid withdrawal from containers may also be through a common manifold. In such cases, there are several appurtenance requirements to control the potential release of product.

If the facility contains a liquid transfer line header (manifold) 1½-inch diameter or larger, and a pressure equalizing vapor line that is 1¼-inch diameter or larger, then continue with the analysis in this section by completing Form 5.3, Form 5.4 and Form 5.5. Otherwise, skip this section and go to section 5.3. *Note: Container appurtenances shown are illustrative of product control equipment only. See NFPA 58 for all container appurtenances required. Illustrations are not intended to be used for system design purposes.*

### Form 5.3 Requirements for Transfer Lines of 1½-inch Diameter or Larger, Liquid-into-Containers

A	B	C	D	E	F
Item #	Appurtenance (Either No. 1 or No. 2)**	Appurtenance Provided with the Feature	Installed in the facility?		NFPA 58 Section Reference (2014 edition)
			Yes	No	
1	Emergency shutoff valve (ESV)  (Ref § 6.12)	Installed within 20 ft. of lineal pipe from the nearest end of the hose or swivel-type connections.			6.12.2
		Automatic shutoff through thermal (fire) actuation element with maximum melting point of 250 °F			6.12.6
		Temperature sensitive element (fusible link) installed within 5 ft from the nearest end of the hose or swivel type piping connected to liquid transfer line.			6.12.6
		Manually operated remote shutoff feature provided for ESV.			6.12.12.1
		Manual shutoff device provided at a remote location, not less than 25 ft., and not more than 100 ft. from the ESV in the path of egress.			6.12.12.2
		An ESV is installed on each leg of a multi leg piping each of which is connected to a hose or a swivel type connection on one side and to a header of size 1½ inch in diameter or larger on the other side.			6.12.5 and 6.19.2.6 (1)
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.			6.12.8

### Form 5.3 (continued)

A	B	C	D	E	F
---	---	---	---	---	---

Item #	Appurtenance	Appurtenance Provided with the Feature	Installed in the facility?		NFPA 58 Section Reference (2014 edition)
			Yes	No	
2	Backflow check valve (BCK)**	Installed downstream of the hose or swivel-type connection			6.12.3
		BCK is designed for this specific application.			6.12.4
		A BCK is installed on each leg of a multi leg piping each of which is connected to a hose or a swivel type connection on one side and to a header of 1½ inch in diameter or larger on the other side.			6.12.5
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.			6.12.8
3	Debris Protection++	Liquid inlet piping is designed or equipped to prevent debris and foreign material from entering the system.			6.19.2.5
4	Emergency discharge control	Flow through facility hose used to transfer LP-Gas from non-metered cargo tank vehicle into containers will stop within 20 seconds of a complete hose separation without human intervention.			6.19.2.6 (3)

\*\* In lieu of an emergency shutoff valve, the backflow check valve (BCK) is only permitted when flow is only into the container and shall have a metal-to-metal seat or a primary resilient seat with metal backup, not hinged with a combustible material (6.12.3, 6.12.4).

++ Retrofit required for existing facilities by July 1, 2011.

### Liquid Withdrawal From Containers

A	B	C	D	E	F
Item #	Appurtenance	Appurtenance Provided with the Feature	Installed in the facility?		NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Emergency shutoff valve (ESV) (Ref § 6.12)	Installed within 20 ft. of lineal pipe from the nearest end of the hose or swivel-type connections.			6.12.2
		Automatic shutoff through thermal (fire) actuation element with maximum melting point of 250 °F.			6.12.6
		Temperature sensitive element installed within 5 ft from the nearest end of the hose or swivel type piping connected to liquid transfer line.			6.12.6
		Manually operated remote shutoff feature provided for ESV.			6.12.12.1
		Manual shutoff device provided at a remote location, not less than 25 ft., and not more than 100 ft. from the ESV in the path of egress.			6.12.12.2
		An ESV is installed on each leg of a multi leg piping each of which is connected to a hose or a swivel type connection on one side and to a header of 1½ inch in diameter or larger on the other side.			6.12.5 and 6.19.2.6 (1)
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.			6.12.8
		<b>Number of ESV's in liquid withdrawal service</b>			

**Note: If more than one ESV is installed in the facility, use one Form 5.4 for each ESV.**

### Form 5.5 Requirements for Vapor Transfer Lines 1¼-inch Diameter or Larger

A	B	C	D	E	F
Item #	Appurtenance	Appurtenance Provided with the Feature	Installed in the facility?		NFPA 58 Section Reference (2014 edition)
			Yes	No	
1	Emergency shutoff valve (ESV) (Ref § 6.12)	Installed within 20 ft. of lineal pipe from the nearest end of the hose or swivel-type connections.			6.12.2
		Automatic shutoff through thermal (fire) actuation element with maximum melting point of 250 °F			6.12.6
		Temperature sensitive element installed within 5 ft from the nearest end of the hose or swivel type piping connected to liquid transfer line.			6.12.6
		Manually operated remote shutoff feature provided for ESV.			6.12.12.1
		Manual shutoff device provided at a remote location, not less than 25 ft., and not more than 100 ft. from the ESV in the path of egress.			6.12.12.2
		An ESV is installed on each leg of a multi leg piping each of which is connected to a hose or a swivel type connection on one side and to a header of 1-1/4 inch in diameter or larger on the other side.			6.12.5 and 6.19.2.6 (1)
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.			6.12.8
2	Backflow check valve (BCK)**	Installed downstream of the hose or swivel-type connection			6.12.3
		BCK is designed for this specific application.			6.12.4
		A BCK is installed on each leg of a multi leg piping each of which is connected to a hose or a swivel type connection on one side and to a header of 1-1/4 inch in diameter or larger on the other side.			6.12.5
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.			6.12.8

\*\* In lieu of an emergency shutoff valve, the backflow check valve (BCK) is only permitted when flow is only into the container and it shall have a metal-to-metal seat or a primary resilient seat with metal backup, not hinged with a combustible material (6.12.3, 6.12.4).

**If a checkmark is made in the “No” column of any one of Form 5.3, Form 5.4 or Form 5.5, then these items must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

**If the LP-Gas facility is designed using ALTERNATE PROVISIONS for the installation of ASME CONTAINERS, then continue the analysis below. Otherwise skip section 5.3 and go to Chapter 6.**

### **5.3 Alternate Provisions for the Installation of ASME Containers**

Facilities may be provided with redundant fail-safe product control measures (section 5.3.1) and incorporate equipment designed for low emissions during transfer operations (section 5.3.2). These types of (redundant and fail-safe) product control measures and low emission transfer equipment provide additional safety and qualify the facility for the following benefits:

- Reduced separation distances from adjacent properties, and
- Mitigation of the need for special protection requirements.

Note that the reduced separation distance applies only to underground and mounded containers 2,001 through 30,000 gallons where all the requirements of NFPA 58 Section 6.28 (summarized in Forms 5.6 and 5.7) are complied with.

#### **5.3.1 ASME Container Appurtenances and Redundant Fail-Safe Product Control Systems**

If the facility incorporates redundant, fail-safe equipment, complete Form 5.6 below. The evaluation will indicate whether the design of the facility complies with the requirements for redundant and fail-safe product control systems. If redundant, fail-safe equipment are not provided, skip this section.

## Form 5.6 Evaluation of Redundant Fail-Safe Design

A I t e m #	B Description		C Features	D		E	F NFPA 58 Section Reference (2014 edition)
				Installed in the facility?		No	
				Yes	No		
1	Container sizes for which the appurtenances are provided		Appurtenances and redundant fail-safe equipment are provided for <u>each</u> container of water capacity 2,001 gal. through 30,000 gal.				6.28.3 and 6.28.4
2	Liquid or vapor withdrawal (1-1/4 in. or larger)		Internal valve having internal excess-flow valve				6.28.3.1 and 6.28.3.2
			Positive shutoff valve installed as close as practical to the internal valve				6.28.3.4
3	Liquid or vapor inlet		Internal valve having internal excess-flow valve or backflow check valve				6.28.3.5
			Positive shutoff valve installed as close as possible to the internal valve or the backflow check valve				6.28.3.5
4	Railcar transfer	Flow into or out of railroad tank car	Approved emergency shutoff valves installed in the transfer hose or the swivel-type piping at the tank car end				6.19.2.6 (1) and 6.28.4
		Flow only into railroad tank car	Approved emergency shutoff valve or backflow check valve installed in the transfer hose or the swivel-type piping at the tank car end				6.19.2.6 (2) and 6.28.4
5	Cargo tank transfer		Protection provided in accordance with 6.12				6.28.4.1
6	Automatic closure of all primary valves (IV & ESV) in an emergency		By thermal (Fire) actuation				6.28.4.2
			Actuated by a hose pull-away due to vehicle motion				6.28.4.2
7	Manually operated remote shutdown of IV and ESV		Remote shutdown station within 15 ft of the point of transfer				6.28.4.3 (A)
			Another remote shutdown station between 25 ft and 100 ft of the transfer point				6.28.4.3 (B)
			Shutdown stations will shut down electrical power supply to the transfer equipment and shut down all primary valves (Internal & Emergency Valves).				6.28.4.3
			Signs complying with the requirements of 6.28.4.3 (C) provided				6.28.4.3 (C)

**Note:** If the facility does not have a rail terminal, write the word NA in both the “Yes” column and the “No” column in item 4 of this Form in the railroad tank car row. Similar option is also available if there is no cargo tank vehicle transfer station.

**If the LP-Gas facility is provided with LOW EMISSION TRANSFER EQUIPMENT, then continue the analysis below. Otherwise skip section 5.3.2 and go to Chapter 6.**

### 5.3.2 Low Emission Transfer Equipment

If the facility is designed with low emission transfer hoses and associated equipment, complete Form 5.7 below. Compliance with Section 6.28.5 of NFPA 58 results in a 50% reduction in the separation distances between transfer points described in Table 6.5.2.1 and Section 6.25.4.3. If the facility does not have low emission transfer equipment engineered into the facility design, skip this section.

### Form 5.7 Evaluation of Low Emission Transfer Equipment

A	B	C		D	E	F
Item #	Description	Features		Installed in the facility?		NFPA 58 Section Reference (2014 Edition)
				Yes	No	
1	Transfer into permanently mounted ASME containers on vehicles	Delivery nozzle and filler valve- Max. liquid release after transfer of 4 cm <sup>3</sup> (0.24 in <sup>3</sup> ).	Fixed maximum liquid level gage not used during transfer operations			6.28.5.3 (A) & (B)
2	Transfer into stationary ASME containers. delivery valve and nozzle combination	During product transfer or post transfer uncoupling of the hose, liquid product volume released to the atmosphere	Does not exceed 4 cm <sup>3</sup> (0.24 in <sup>3</sup> ) from a hose of nominal size 1 in or smaller			6.28.5.4 (A)
			Does not exceed 15 cm <sup>3</sup> (0.91 in <sup>3</sup> ) from a hose of nominal size larger than 1 in.			6.28.5.4 (B)
3	Transfer into stationary ASME containers maximum filling limit	Do containers of less than 2,001 gal (w.c.) have an overfilling prevention device or another approved device?				6.28.5.4 (F)
		Do containers 2,001 gal (w.c.) or greater have a float gage or other non-venting device?				6.28.5.4 (E)
4	Transfer into stationary ASME containers fixed maximum liquid level gage	Not used during routine transfer operations but used to calibrate other non-venting liquid level gages in the container				6.28.5.4 (C) & (D)

**Note:** 1) If the facility does not have a particular feature described in items 2 or 3, write "NA" in both the "Yes" and "No" columns corresponding to its row .

**If separation distance reductions are intended, checkmarks made in the "No" column of either Form 5.6 or Form 5.7 must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

# CHAPTER 6

## Analysis of Local Conditions of Hazard

### 6.1 Physical Protection Measures

Protection should be provided for LP-gas facilities, systems and appurtenances against the risk of tampering and from the accidental collision of vehicles with containers and/or transfer lines. Requirements to prevent such tampering or accidents are specified in the code. Compliance requirements for the facility are indicated in Form 6.1. Complete all forms in this chapter. (NOTE: See NFPA 58 for complete requirements.)

**Form 6.1**  
**Evaluation of Physical Protection and Other Measures**

A #	B Item	C Features	D		E NFPA 58 Section Reference (2014 Edition)
			Installed in the facility?		
			Yes	No	
1	Lighting‡	Provide lighting for nighttime operations to illuminate storage containers, container being loaded, control valves, and other equipment			6.19.5
2	Vehicle impact protection	Protection against vehicular (traffic) impacts on containers, transfer piping and other appurtenances is designed and provided commensurate with the size of vehicles and type of traffic in the facility. (Example protection systems include but not limited to (1) Guard rails, (2) Steel bollards or crash posts, (3) Raised sidewalks.			6.6.1.2 and 6.9.3.10
3	Protection against corrosion	Provide protection against corrosion where piping is in contact with supports or corrosion causing substances.			6.9.3.11, 6.9.3.14, and 6.17
<b>Complete only 4A or 4B</b>					
4 A	Perimeter Fence	Is an industrial type or chain link fence of at least 6 ft high or equivalent protection provided to enclose (all around) container appurtenances, pumping equipment, loading and unloading and container filling facilities?			6.19.4.2
		Are at least two means of emergency egress (gates) from the enclosure provided? <b>NOTE: Write “N.A.” (not applicable) if</b> (i) The area enclosed is less than 100 ft <sup>2</sup> , or (ii) The point of transfer is within 3 ft of the gate, or containers are not filled within the enclosure			6.19.4.2 (A)
		Is a clearance of at least 3 feet all around to allow emergency access to the required means of egress provided?			6.19.4.2 (B)
	Guard Service	If a guard service is provided, does this service cover the LP-Gas plant and are the guard personnel provided with appropriate LP-Gas related training, per section 4.4 of NFPA 58?			6.19.4.3
4 B	Lock-in-Place devices	Are Lock-in-Place devices provided to prevent unauthorized use or operation of any container appurtenance, system valves, or equipment in lieu of the fence requirements above?			6.19.4.2 (C)

**Note:** Fill only items 1, 2, 3, and 4A or 4B. Indicate with “NA” when not filling the “Yes” or “No” column.

‡ Indicate with “NA” if the facility is not operated at night.

## 6.2 Ignition Sources and Control

The potential for the ignition of LP-Gas vapors released in a facility is reduced by eliminating as many ignition sources as possible, designing electrical equipment to reduce or eliminate sparking and ensuring that during transfer operations known ignition sources are turned off. The ignition source control involves both passive methods as well active methods. Form 6.2 is used to evaluate whether your facility satisfies the code requirements for ignition source control. (NOTE: See NFPA 58 for complete requirements.)

### Form 6.2 Assessment of Sources of Ignition and Adjacent Combustible Materials

A	B	C	D	E
#	Sources of Ignition and Requirements Pertaining to Adjacent Combustible Materials	Is the Facility compliant?		NFPA 58 Section Reference (2014 Edition)
		Yes	No	
1	Are combustible materials not closer than 10 ft. from each container?			6.4.4.3
2	Is a distance at least 20 ft. provided between containers and tanks containing flammable liquids with flash point less than 200 °F (ex., gasoline, diesel)?			6.4.4.6
3	Are electrical equipment and wiring installed per Code requirements?			6.23.2
4	Is open flame equipment located and used according to Code?			6.23.3.1
5	Are ignition control procedures and requirements during liquid transfer operations complied with?			7.2.3.2
6	Is an approved, portable, dry chemical fire extinguisher of minimum capacity 18 Lbs. and having a B:C rating provided in the facility?			6.27.4.2
7	Is an approved, portable, dry chemical fire extinguisher of minimum capacity 18 Lbs. and having a B:C rating provided on each truck or trailer used to transport propane?			9.3.5 and 9.4.7
8	Is the prohibition on smoking within the facility premises strictly enforced?			7.2.3.2 (B) and 9.4.10

**Note:** Insert "NA" in both "Yes" and "No" columns of any items that are not applicable.

## 6.3 Separation Distances

### 6.3.1 Separation Distances between Container and Important Buildings, Other Properties and Transfer Points

The separation distance provisions in NFPA 58 are minimum requirements and are intended to buy time in an emergency and to implement appropriate response. The requirements are dependent upon the size of the container. Complete the appropriate section of Form 6.3. (NOTE: See NFPA 58 for complete requirements.)

#### Form 6.3

#### Separation Distances from Containers to Buildings, Property Lines that can be Built upon, Inter-container Distances, and Aboveground Flammable or Combustible Storage Tanks

A #	B Container Size Range in gal (W.C.)	C Separation between a property line, important building or other property and the <u>nearest</u> container which is	D Minimum Distance (ft)	E Is the Facility compliant?		G NFPA 58 Section Reference (2014 Edition)
				Yes	No	
1	501 through 2,000	Aboveground	25			6.3.1, 6.3.2 and Table 6.3.1.1
		Underground or Mounded	10			
		Between containers	3			
2	2,001 through 30,000	Aboveground	50			
		Underground or Mounded	50			
		Between containers	5			
3	30,001 through 70,000	Aboveground	75			
		Underground or Mounded	50			
		Between containers	¼ sum of diameters of adjacent containers			
4	70,001 through 90,000	Aboveground	100			
		Underground or Mounded	50			
		Between containers	¼ sum of diameters of adjacent containers			
5	All sizes greater than 125 gal	Separation distance between an aboveground LP-Gas container and an aboveground storage tank containing flammable or combustible liquids of flash points below 200 °F.	20			6.4.4.6 and 6.4.4.7

**If the LP-Gas plant is provided with every one of the redundant and fail-safe product control-design equipment indicated in Form 5.6, then the minimum distance in column D of Form 6.3 can be reduced to 10 feet for underground and mounded containers of water capacity 2,001 gal to 30,000 gal**

**Note:** If any of the container sizes indicated in the above form are not present in the facility, enter "NA" in both Yes and No columns.

### 6.3.2 Separation Distances between Transfer Points and other Exposures

If the liquid transfer point is not on the container but is at a remote location complete Form 6.4.

**Do not complete Form 6.4 when the filling is through a container valve.**

(NOTE: See NFPA 58 for complete requirements.)

## Form 6.4

### Separation Distances between Points of Transfer and other Exposures

A #	B Type of Exposure within or outside the facility boundary		C Check if exposure is present	D Minimum Distance (ft)	E Is the Facility compliant?		G NFPA 58 Section Reference (2014 Edition)
					Yes	No	
1	Buildings, mobile homes, recreational vehicles, and modular homes with at least 1-hour fire-rated walls			10			Section 6.5.2 and Table 6.5.2.1
2	Buildings with other than at least 1-hour fire-rated walls			25			
3	Building wall openings or pits at or below the level of the point of transfer			25			
4	Line of adjoining property that can be built upon			25			
5	Outdoor places of public assembly, including school yards, athletic fields, and playgrounds			50			
6	Public ways, including public streets, highways, thoroughfares, and sidewalks	From points of transfer in LP-Gas dispensing stations and at vehicle fuel dispensers.		10			
		From other points of transfer		25			
7	Driveways			5			
8	Mainline railroad track centerlines			25			
9	Containers other than those being filled			10			
10	Flammable and Class II combustible liquid dispensers and the fill connections of non-stationary containers			10			
11	Flammable and Class II combustible liquid aboveground containers and filling connections of underground containers			20			
12	LP-Gas dispensing device located close to a Class I liquid dispensing device.			10			6.25.4.3

**NOTE:** Place a checkmark in column C against an exposure that is present in or around the facility. Fill columns E or F for only those rows for which there is a checkmark in column C.

**If the facility contains low emission transfer equipment (i.e, all equipment identified in Form 5.7 are installed and are in working order), then the minimum separation distances in column D of Form 6.4 can be reduced to one half of the indicated values.**

**If the containers in the LP-Gas facility are provided with SPECIAL PROTECTION MEASURES, then continue the analysis below. Otherwise skip Forms 6.5 and 6.6 and go to Section 6.5. Also see Chapter 9.**

## 6.4 Special Protection

In the event that a proposed installation is adjacent to a property containing extremely high combustible fuels and the location of the storage containers is such that exposure of the containers to a fire on the adjacent property would severely impact the integrity of the containers, special protection methods may be utilized to reduce the exposure hazard to the containers. Installed special protection systems must comply with section 6.27.5 of NFPA 58, which addresses both passive and active protection systems.

- Passive approaches include insulating the outside of the containers, mounding above grade or burying the container.
- Active special protection includes fixed water spray systems or placement of monitor nozzles at strategic locations with respect to the containers to be protected.

Complete form 6.5 to determine compliance of the installation with the code. Similarly, Form 6.6 indicates the requirements for active protection. This Form also should be completed as part of the fire safety analysis process.

(NOTE: See NFPA 58 for complete requirements.)

### Form 6.5 Special Protection Measures –Passive Systems

A	B	C	D		E
#	Special Protection Option	Question	Is the Facility compliant?		NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Container Insulation	Insulation provided on each of the containers?			6.27.5.1
		Insulation material complies with the requirements of NFPA 58?			6.27.5.1 and 6.27.5.2
2	Mounding of containers	Each container in the facility is mounded?			6.27.5.3
		Mounding complies with each requirement under section 6.6.6.3 of NFPA 58.			6.6.6.3 and 6.27.5.3
3	Burying of containers	Each container in the facility is buried?			6.27.5.4
		Buried containers comply with each requirement under section 6.6.6.1 of NFPA 58.			6.6.6.1 and 6.27.5.4

## Form 6.6 Special Protection Measures –Active Systems

#	Special Protection Option	Question	Is the Facility compliant?		NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Water spray systems	Are fixed water spray systems, complying with NFPA 15 <sup>1</sup> requirements, used for each container in the facility?			6.27.6.1
		Do fire responsive devices actuate water spray system automatically?			6.27.6.2
		Can the water spray systems be actuated manually also?			6.27.6.2
2	Monitor nozzle systems	Are the monitor nozzles located and arranged so that the water stream can wet the surfaces of all containers exposed to a fire?			6.27.6.3
		Can the water stream from a monitor nozzle reach and wet the entire surface of, at least, one half of a length from one end of each of the containers it is designed to protect? <sup>1</sup>			6.27.6.3
		Do fixed monitor nozzles comply with NFPA 15 <sup>2</sup> requirements?			6.27.6.1
		Do fire responsive devices actuate the monitor nozzles?			6.27.6.2
		Can the monitor nozzles can be actuated manually also?			6.27.6.2

1. See discussion in Section 8.2

2. Refer to Chapter 8 for a discussion on NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*

## 6.5 Vehicular Protection

In the event that an installation is located where an immediate threat due to vehicular traffic is present, a barrier or other suitable protection may be necessary.

## Form 6.7 Protection Against Vehicular Impact

#	System Protected	Is physical protection provided?		Type of physical protection installed	NFPA 58 Section Reference (2014 Edition)
		Yes	No		
1	Storage containers				6.6.1.2, 6.6.6.1(B), 6.6.6.1(C), 6.9.3.10, and 6.25.3.13
2	Transfer stations				
3	Entryway into plant				

## CHAPTER 7

### Exposure To and From Other Properties, Population Density

#### 7.1 Exposure to Off-Site Properties and Persons From In-Plant Propane Releases

**Types of Propane Fires:** A propane release inside the LP-Gas facility may affect adjacent properties and off-site populations if the release is of a sufficiently large size. An immediately ignited release will result in a local fire. Depending upon the characteristics of the release and ignition two types of local fires can occur, namely, a pool fire on any liquid pool of propane on the ground or a burning rising fireball.

If the released propane is not immediately ignited, then a dispersing cloud (or plume) of vapor will form. The cloud or plume will move in the direction of the wind. Because of the mixing of air with the dispersing propane, propane concentration decreases continuously both with downwind distance as well as in the crosswind direction. This cloud or plume can be ignited at any distance downwind by an ignition source when the concentration at the point of ignition is within the Lower Flammability Limit (LFL) to Upper Flammability Limit (UFL) range. For propane the range of flammable concentrations in air is between 2.15% and 9.6% by volume.

Ignition of a dispersing vapor cloud or plume may result in a flashback type of vapor fire. In extremely rare cases, and only when the physical conditions are conducive, with partial or full confinement of the propane-air mixture of proper concentration and its ignition, a vapor explosion can occur, resulting in a blast wave. If the dispersing cloud is not ignited it poses no hazard to the surrounding area.

Propane vapor at ambient pressure and temperature is heavier than air. Hence, any vapor released will tend to flow towards and accumulate in low-lying areas adjacent to the release location. If a building or other semi-confined area exists adjacent to the release location wherein the vapor can accumulate in the lower parts of the building, a potential explosion hazard will result.

**Hazardous Effects of a Fire:** The effect of a propane fire on an off-site property will depend on the type and material of construction of the structure and its distance from the fire and fire size. Similarly, the number of off-site persons adversely impacted by a fire inside a LP-Gas facility will also depend on, (in addition to the characteristics of the fire and the distance between the fire and the population) the type of population, the timeliness of notification, the effectiveness of the evacuation planning and implementation, etc.

**Release Cases:** In this manual, a number of mathematical models were developed for credible accident scenarios, to describe the effects of the release of propane inside LP-Gas facilities and its subsequent behavior. These models were used to calculate potential hazard areas for each scenario of release. Each potential release discussed has very low probability of occurrence. However, because of the flammability of propane, such releases may pose hazards. The hazard distance (to a

property outside the facility boundary or to off-site persons) from a propane release within the facility will depend on the size and duration of release, and the type of fire that occurs.

The calculated distance to which a hazard extends under each scenario of release and for each hazard behavior is indicated in Table 7.1.

To assess the hazards posed to offsite population from in-plant releases of propane it is necessary to:

1. Note the type of occupancies surrounding the facility, and
2. Describe in detail the characteristics and density of the population surrounding the facility.

To evaluate the impact on the surrounding population from an in-plant propane release, complete Form 7.2 using the results indicated in Table 7.1.

**Table 7.1**  
**Distances to Various Types of Propane Hazards Under Different Release Models\*\***

Model #	Details of the Propane Release Model Releases from or due to		Vapor Dispersion Distance to LFL (ft)	Explosion Hazard Distance (ft)	Fire Ball Radiation Distance (ft)
1a	Bobtail hose failure. Release of the entire inventory in the hose, quickly.	1" ID x 150 ft hose length	250	110	50
1b		1" ID x 120 ft hose length	230	103	45
1c		1" ID x 75 ft hose length	190	90	40
2a	Release of the inventory in a transfer piping 1" x 30 ft @ 20 gpm for 10 min., due to failed excess flow valve.		135	120	25
2b	Release of the inventory in a transfer piping 2" x 30 ft @ 80 gpm for 10 mins.		230	252	48
2c	Release of the inventory in a transfer piping 2" x 80 ft. @ 70 gpm for 10 mins.		328	235	74
2d	Release of the inventory in a transfer piping 2.5" x 30 ft @ 80 gpm for 10 mins.		269	252	59
2e	Release of the inventory in a transfer piping 3" x 30 ft @ 100 gpm for 10 mins.		312	287	69
2f	Release of the inventory in a transfer piping 3" x 18 ft @ 100 gpm for 10 mins.		256	284	55
2g	Release of the inventory in a transfer piping 3" x 80 ft @ 100 gpm for 10 mins		455	284	106
2h	Release of inventory from transfer piping 4" x 30 ft. + 200 gpm for 10 minutes		407	410	89
3	Release from the container pressure relief valve		No ignitable vapor concentration at ground level		
4	Release from a 1" ID x 150 ft transfer piping to a vaporizer and reduced flow from a partially open excess flow valve @ 20 gpm for 10 min.		250	120	50
5	Leak from a corrosion hole in a transfer pipe at a back		110	120	5

	pressure of 130 psig (corresponding to 80 °F) for 60 min. Hole size is ¼" ID.			
6a	Release of the entire inventory in a 2" ID x 20 ft., transfer hose.	195	90	40
<b>Model #</b>	<b>Details of the Propane Release Model Releases from or due to</b>	<b>Vapor Dispersion Distance to LFL (ft)</b>	<b>Explosion Hazard Distance (ft)</b>	<b>Fire Ball Radiation Distance (ft)</b>
6b	Release of the entire inventory in a 2.5 inch dia. transfer hose x 16 ft. length	215	98	45
6c	Release of the entire inventory in a 3-inch dia. transfer hose x 12 ft. length	230	100	46
6d	Release of the entire inventory in a 1.25-inch diameter transfer hose x 20 ft. in length	138	66	27
7a	Transport hose blow down: Hose size 2" ID, 20 ft length release for 3min., from a Transport after the tank is filled.	25	30	<5
7b	Transport hose blow down: Hose size 2.5" ID, 16 ft length release for 3min., from a Transport after the tank is filled.	25	29	<5
7c	Transport hose blow down: Hose size 3" ID, 16 ft length release for 3min., from a Transport after the tank is filled.	31	36	<5

\*\* Results from models described in Appendix B.

### Form 7.1 Types of Occupancies<sup>(1)</sup> Near or Surrounding the LP-Gas Facility

Type of Occupancies	Model # from Table 7.1	Hazard Distance <sup>(2)</sup> (feet)	Is Occupancy located within the hazard distance from the Facility?	
			Yes	No
<b>Assembly Occupancies</b> (Places of worship, Libraries, Theaters and Auditoriums, Food or Drink Bars, Sports Stadiums, Amusement Parks, Transportation Centers, etc. with 50 or more people).				
<b>Institutional Occupancies</b> (Elderly Persons Home or Nursing Home, Hospitals, Alcohol & Drug Rehabilitation Centers, Prisons)				
<b>Educational Occupancies</b> (Elementary Schools, Day Care facilities, etc).				

**NOTES:** (1) Different types of occupancies are defined in NFPA 5000

(2) Table 7.1 provides a number of scenarios that can result in propane release, and the resulting area exposed for different ignition mechanisms. Determine the scenarios that are applicable to the facility, for the quantities that can be released, and enter the greatest value from Table 7.1. Use the hose diameters and length that will be used at the facility if they differ from the ones in Table 7.1 and recalculate the hazard distances using a spreadsheet method that is available at [npga.org](http://npga.org). Some scenarios may not be applicable to an installation because of other mitigation measures implemented, such as a hose management procedure to minimize the possibility of hose failure.

## 7.2 Exposure to the Propane Facility From External Events

A large fire or an explosion occurring outside the plant boundary may have detrimental effects on the plant equipment, containers or electrical systems. The most likely scenario is that the LP-Gas plant equipment is affected by intense heat radiation from the external fire.

In order to assess the effects on in-plant personnel, equipment, containers and safety systems from exposure to off-site hazards it is necessary to:

- 1 Identify industrial or other operations surrounding the LP-Gas plant and also note the type of occupancies surrounding the plant;
- 2 Discuss with owners of facilities or operations surrounding the LP-Gas plant any potential detrimental effect due to their presence or operations upon the LP-Gas plant;
- 3 Implement suitable precautions and develop quick notification or other effective communication system protocol between the LP-Gas plant and its neighboring industrial plants, to minimize the potential detrimental effects on a proposed LP-Gas plant from surrounding operations.

The description of the LP-Gas plant surroundings was specified in Form 4.2. Form 7.2 should be completed as a part of the Fire Safety Analysis to note any outside hazards that may affect the integrity of the LP-gas system.

### Form 7.2 Exposure to LP-Gas Facility from External Hazards

A	B	C	D
Item #	Type of Neighboring Operation	Hazard exists to the LP-Gas Facility	
		Yes	No
1	Petroleum and other hazardous material storage, wholesale dispensing, etc.		
2	Metal cutting, welding, and metal fabrication		
3	Industrial Manufacturing that can pose external hazards		
4	Ports, rail yards and trans-shipment terminals handling flammable and explosive materials.		
5	Other operations that may pose hazards (gasoline and other hazardous material dispensing stations, fertilizer storage, etc).		

**NOTE:** If a particular activity indicated in column B does not exist, fill both "Yes" and "No" columns with "NA."

Where a "Yes" has been checked in either Form 7.1 or Form 7.2:

- 1) For an existing facility, communicate this information to local emergency responders for inclusion in their emergency planning.
- 2) For a proposed facility, implement the actions indicated in Chapter 9.

**External Fire Effects on LPG Containers:** An evaluation of the effects of thermal radiation from fires outside the facility on LP containers in the LPG plant was conducted to provide guidance to those using this manual. (This evaluation, the associated mathematical model and detailed results with and without the effects of wind have been published in a peer reviewed technical journal)<sup>1</sup>. The maximum temperature attained by the vapor-wetted wall of a propane container exposed to heat radiation from an external, non-impinging fire was calculated for various sizes of containers. The assumptions made in regard to the size and location of the external fire included the following:

- The fire used in the model was a highly radiative liquid hydrocarbon pool fire. The value assumed for the heat radiation emanating from this liquid pool fire was greater than that from fires occurring due to the burning of wooden buildings, tires, forest trees, and other flammable liquids such as oil fires, which burn with high degree of smoke production.
- A fire diameter of 100 ft (30.5 m) was used for duration of 30 minutes. This is a very large fire.
- The edge of the fire was located at distances to buildings required by Table 6.3.1.1 of NFPA 58 and consistent with the size of the container nearest to the plant boundary.
- Convective cooling of the heated surface and the effects of reflective paint on the containers were included.
- Bending of the fire plume towards the containers due to the effects of wind was also included.

The maximum temperatures calculated for the steel surface of the container in contact with vapor in different size containers were as follows:

Container Size Gal. (W.C.)	Maximum Temperature attained in 30 min exposure
1,000	660 °F
2,000	648 °F
4,000	507 °F
12,000	507 °F
18,000	437 °F
30,000	384 °F
60,000	340 °F

---

<sup>1</sup> Raj, P.K., "Exposure of a liquefied gas container to an external fire," Journal of Hazardous Materials, v122, Issues 1-2, p 37-49, June 2005.

The temperature at which the yield strength of steel of a propane tank begins to decrease is close to 800 °F. Based on this, there is no threat of propane tank failure from thermal radiation from an external fire occurring at the minimum separation distances specified in Table 6.3.1.1 of NFPA 58.

## CHAPTER 8

### Evaluation of Fire Services and Water Supply Requirements

In this chapter the procedure for evaluating the capability and resources of the local fire department (FD) that would respond to an emergency at the LP-Gas facility is discussed. This evaluation includes the training of FD personnel, availability of suitable fire apparatus and equipment, and determination of water requirements if such a system were to be installed at the facility.

#### **8.1 Details of the Fire Service**

Use Form 8.1 to record the relevant data on personnel and resources from the local FD or fire company that is responsible for the area where the LP-Gas facility is located. This is a good opportunity to establish a working relationship with the fire department as you will need their support as you go forward with this planning and evaluation process and they will need to understand the facility to provide maximum assistance should an incident occur at the facility.

**Analyzing the data from Form 8.1:** The designation of the fire fighters as career personnel or volunteers has no bearing on the expertise of the department. The purpose of items 4 and 5 in Form 8.1 is to help determine how fast the initial help might be available. Career fire fighters are in the station and available to respond. Volunteer fire fighters may have to come from home or their place of business. Career fire fighters can normally have a piece of fire apparatus responding within one minute of receiving the call, volunteers may take 4-5 minutes to reach the station before they can respond.

Item # 6 helps determine the level of skill of the fire fighters in the fire department. NFPA 1001, *Standard for Fire Fighter Professional Qualifications*, defines the expertise required of a fire fighter to be qualified to Levels I and II. A Level I fire fighter can do general fire fighting tasks under close supervision and a Level II fire fighter can do those and more tasks under general supervision.

Item # 7A is critical to determining if an effective operation can be conducted. For fighting a fire, at least two fire fighters are required for each 125 gpm hose line used. In addition, an incident commander, a safety officer, additional supervisory officers (depending on the size of the incident), and an operator for each piece of fire apparatus that is being used (pumping or performing some other function) is required. Also required is a rapid intervention crew (RIC) of 2 fire fighters when the first firefighting crew is deployed into a hazardous area, with that team growing to 4 fire fighters when the second and subsequent crews enter the hazardous area. The role of the RIC is to perform a rescue of one or more fire fighters that may be injured during the operation.

Item # 7B and Item # 7C help determine the training and knowledge of the fire fighters in hazardous materials and the specific hazards of LP-Gas. NFPA 472 is *Standard for Competence of Responders to Hazardous Materials/Weapons of Mass Destruction Incidents*.

## Form 8.1

### Data on the Responding Fire Department

A	B		C
Item #	Data Item		Data Entry
1	Name of the Fire Department (FD).		
2A	Name of the person in the FD assisting with the data acquisition.		
2B	Position of the person in the FD assisting with the data acquisition.		
3A	Date on which FD data was collected.		
3B	Name of the person collecting the data.		
4	Number of fire fighters on duty at any time.		
5	Average number of fire fighters available for response.		
6A	Number of fire fighters qualified to	“Fire Fighter I” level.	
6B		“Fire Fighter II” level.	
7A	Number of fire fighters who would:	Respond on the first alarm to the facility.	
7B		Respond on the first alarm and who are qualified to the operations level requirements of NFPA 472 or <u>similar</u> local requirements	
7C		Respond on the first alarm with specific knowledge and training on the properties of LP-Gas and LP-Gas fires.	
8A	Number of fire apparatus that have the capability to deploy a 125 gpm hose line supplied by onboard water for at least 4 minutes, and, which:	Are in service in the department.	
8B		Would respond on a first alarm.	

Item # 8A and Item # 8B help determine the capability of fire apparatus that will or could respond to an incident. A 125 gpm hose line is a typical hose line used for firefighting where the fire fighters are expected to advance and maneuver the line while it is flowing.

**Response time:** Another important consideration of the effectiveness of the Fire Department to respond to an incident is the time it takes the FD to reach the LP-Gas facility. Many fire departments have multiple fire stations or use mutual aid fire companies from other communities to assist them so resources are coming from different locations. It is therefore important to determine the total time for not only the first arriving apparatus but for subsequently arriving apparatus dispatched on the first alarm as well. You will need to work with the fire department and gather this information as well.

Using Form 8.2, determine the time for all resources that would be dispatched on the first alarm to an emergency at the facility. Start by identifying and listing in column A the fire companies that would respond on a first alarm to an emergency. Then, for each company record the time it would take to receive and handle an alarm, for the company to turnout, and the time to respond. If the fire department does not have data that can help, some good averages to use are:

- **Alarm Receipt & Handling Time** - 1 minute for the fire department first receiving the alarm and 3 minutes for mutual aid fire departments,
- **Turnout Time** - 1 minute if the apparatus is staffed by career fire fighters and 4 minutes if the apparatus is staffed by volunteer fire fighters,
- **Travel Time** - 2 minutes for each mile the fire apparatus must travel in an urban/suburban setting and 1.5 minutes for each mile the fire apparatus must travel in a rural setting.

Total the times in columns B, C, and D for each company and enter the sum in Column E. This response time will give you an idea of how long it will take resources to reach the facility gate. Fire fighters must then determine the nature and severity of the emergency, determine how they are going to deal with the emergency, maybe establish a water supply from a hydrant or other source, and implement their attack. This can take anywhere from a couple of minutes to upwards of 30 minutes.

## **8.2 Water Needs and Availability**

The requirements for water to cool a container exposed to a fire are indicated in NFPA 15. A flow rate of 0.25 gpm/ft<sup>2</sup> (10 liter/min/m<sup>2</sup>) is specified as being adequate to cool a LP-Gas container exposed to a fire. Since a majority of the containers in the LP-Gas facilities have container penetration for liquid inflow or liquid outflow at only one end of the container and since any product leak occurring at one end and a subsequent fire will affect only the end zone of a container, it has been assumed that the container surface within only one half length of the container needs to be cooled for an effective prevention of damage to the container. Also, calculate the total volume of water required on the basis of a stream flow time of 10 minutes.

Based on these parameters and the surface area of various size ASME containers, the cooling water rate requirements for each container size are determined using Form 8.3. Complete Form 8.3 with information relevant to the facility. Start by identifying the largest container at the facility. Assume that a fire occurs at the end of that container where the appurtenances for

product inflow and outflow are located, and determine whether other containers are within 50 feet of this largest container.

Identify the largest container at the facility and all stationary containers within 50 feet of the largest container. Record in column F of Form 8.3 the largest container. Next, record in Column F the two containers that are within 50 feet of the largest, **and** which have the most surface area exposed to the end of the largest container at which the appurtenances are installed. These are the containers, which are most likely to be affected by a fire occurring at the appurtenances of the largest container. Multiply the number of containers recorded in Column F by the required water flow rate per container in Column E and enters the result in Column G. Sum the values in Column G and enter the sum in Cell 2a, Column G. Round this number up to the next multiple of 125 (i.e. 725 gpm would round up to 750 gpm). This is done because the application of water by the fire department is generally going to be in increments of 125 gpm. Enter that figure in Cell 2b, Column G.

You have now determined the application rate for cooling water that is necessary if the largest container is subjected to fire. Add 250 gpm (Cell 3, Column G) for use by fire fighters to protect personnel when approaching the container or its valves to control the flow of product. Sum the numbers in Cells 2b and 3 of Column G. Enter that number in Cell 4, Column G.

To determine the total volume of water required for a 10-minute application time, multiply the total water flow rate in Cell 4, Column G by 10 and enter that figure into Cell 4, Column H.

## Form 8.2

### Response Time data for the Fire Departments

A	B	C	D	E
<b>Company or Department</b>	<b>Time in Minutes for</b>			
	<b>Alarm Receipt &amp; Handling</b>	<b>Turnout</b>	<b>Travel</b>	<b>Total Time</b>

**Note:** Number in Column E = Sum of numbers from Columns B through D.

## Form 8.3

### Water Flow Rate and Total Water Volume Required to Cool Containers Exposed to a Fire

A	B	C	D	E	F	G	H
Item #	ASME Container Size (gallons)	Total Surface Area of each Container <sup>1</sup> (ft <sup>2</sup> )	Surface Area of each container to be Cooled (ft <sup>2</sup> )	Water flow rate required per container (gpm)	Number of containers of the size indicated‡	Total Water flow rate required (gpm)	Total volume of water required for 10 min (gal)
1	500	86	43	10.8			
	1,000	172	86	21.5			
	2,000	290	145	36.3			
	4,000	374	187	46.8			
	6,500	570	285	71.3			
	9,200	790	395	98.8			
	12,000	990	495	123.8			
	18,000	1,160	580	145.0			
	30,000	1,610	805	201.3			
	45,000	2,366	1,183	295.8			
	60,000	3,090	1,545	386.3			
	90,000	4,600	2,300	575.0			
Other Size							
2a	Calculated water flow rate for container protection						
2b	Water flow rate rounded up to nearest multiple of 125						
3	Water for fire fighter protection, if required					250	
4	Total water flow rate and volume						

**Note:** Column D = (1/2) x Column C

Column E = 0.25 (gpm/ft<sup>2</sup>) x Column D ;

Column G = Column F x Column E

Column H = 10 x Column G

Line 2a, Column G and Column H are the sum of numbers in each row above line 2 of each column.

Line 4, Column G and Column H are the sum of numbers in rows 2b and 3.

‡ Consider only 3 containers for water supply evaluations even if the number of containers in a group is more than 3. See Section 8.2.

<sup>1</sup> ASME container approximate dimensions

**The total water requirement for the facility is indicated in item 4, column G (water flow rate) and column H (total water volume or quantity) of Form 8.3. If multiple groups of containers are present in the facility, repeat the calculations in Form 8.3 for each group of containers. The total water requirement for the facility is the largest value for any single group of containers.**

## **Water Availability Evaluation**

If a water system is installed, Form 8.3 calculates the total water requirement for a 10-minute duration. This time period allows for manual shutdown, rescue of any injured, and the possibility of dispersing unignited gas.

If there is a public or private water supply with hydrants available within 1000 feet of the container or containers on which water will be applied, determine the available flow rate from that system with 20 psi residual pressure. The water company may have flow test data or it may be necessary to conduct flow tests. If that flow rate is equal to or greater than the needed flow rate determined using Form 8.3, you can assume your water supply is adequate. If the hydrant flow rate is less than the needed flow rate, determine what other sources of water are available. Sources fall into two categories: water on fire apparatus responding to the incident, and water in rivers, ponds or lakes near the facility. Start by talking with the fire department about whether they have a tanker shuttle capability. Some departments have well-organized operations that can deliver 250 gpm or more on a continuous basis using tanker shuttles. This may be the only capability available or it may be a supplement to a weak hydrant system. Be sure to determine how long it would take to get the water shuttle established.

If there is a river, pond or lake in the area, the fire department may be capable of drafting from that water source and pumping water through hose lines to the facility. There are a number of things that need to be considered before relying on this type of water supply.

1. Can a fire apparatus get close enough to the water source to reach the water with the suction hose it carries (normally 20 feet) and not have the lift (distance from the surface of the water to the center of the pump) greater than 10 feet?
2. Is the water source available year round? Does it dry up in the summer or freeze in the winter? The strainer on the suction hose needs to be at least 2 feet below the surface of the water.
3. Is the water source of adequate size or flow to supply the water needed?
4. Does the fire department have the hose and pumping apparatus to relay the water from the source to the fire?
5. How long will it take to set up this relay?

These factors should be evaluated and discussed with the fire department before any decision is made to use such a supply. It might also be useful to have the fire department conduct an actual timed drill to deliver the needed water supply to the facility site using the normally responding complement of personnel and equipment.

Complete Form 8.4 to document the water supply that will be available to the facility site.

## Form 8.4

### Evaluation of Water Availability in or Near the LP-Gas Facility

A	B	C	D		
Item #	Water from...	Available?	Quantitative information		
1	Public supply or from another piped-in supply through one or more fire hydrants in or near the facility	<input type="checkbox"/> Yes <input type="checkbox"/> No	Hydrant data	Distance from Container(s) on which water will be applied (feet)	Available water flow rate from all hydrants <sup>(1)</sup> (gpm)
			Hydrant 1		
			Hydrant 2		
			Hydrant 3		
2	A nearby static water source (stream, pond, lake, etc).	<input type="checkbox"/> Yes <input type="checkbox"/> No	Distance to water source = _____ Feet Time to set up relay = _____ min. Rate of delivery = _____ gpm		
3	Only through mobile water tanker shuttle.	<input type="checkbox"/> Yes <input type="checkbox"/> No	Time to set up shuttle = _____ min. Sustainable flow rate = _____ gpm		

(1) Obtain the available flow rate from the local municipal water authority or the entity that supplies water to the hydrant or conduct a test to determine total available flow rate.

Having the water available does not guarantee that the fire department has the resources to apply the water in a timely manner. Completed Form 8.2 will indicate how much time it will take for the fire department to have initial resources at the facility and how long before additional resources will be on-site. If the capability to apply cooling water within the first 10 minutes of initial fire exposure to the container is not present, extremely dangerous conditions could begin to develop. Note that it will take several minutes after the apparatus arrives at the facility gate before cooling water is actually applied to the containers and that hand held hose lines will be used with water supplied from the water tank on the apparatus. Even if hydrants are available, the staffing on the first arriving fire apparatus will probably not be sufficient to establish a water-supply from the hydrant. Depending on the hydrant system and the fire department's standard operating guidelines, it may be necessary to connect a pumper to the hydrant. If the distance is over 1000 ft. it may also be necessary to use hose from more than one fire apparatus to reach the hydrant and in some cases, to use intermediate pumpers in the hose line to boost the pressure.

Form 8.1 contains information on responding apparatus capable of applying 125 gpm for 4 minutes. This is adequate to begin operations for a single container of 30,000 gallons or less water capacity if no other adjacent containers are exposed to the fire. However, a continuous water supply then has to be established within that 4 minutes or other apparatus must be available with onboard water to continue the cooling until a continuous water supply is set up. A larger facility or multiple containers exposing each other is a different situation. In those cases, cooling water may need to be applied using larger hand held hose lines or ground monitors to achieve the reach necessary with the water stream. Both of these require considerably more water than may be supplied by 125 gpm hose lines. Unless a hydrant system with an adequate flow rate is readily available, the time needed to establish an adequate water supply from remote hydrants, a relay operation from a static water source, or a sustainable tanker shuttle operation will greatly exceed the initial 10 minutes of fire exposure to the container and dangerous conditions could begin to develop. For these facilities, a fixed water spray system is the only practical means by which adequate protection can be provided to installations consisting of multiple 30,000 gallon or larger containers.

Using the data you have gathered, it is recommended that you discuss with the fire department the resources available to protect the facility. This would include evaluating the knowledge and training of the fire fighters who would be arriving at the facility.

- 1) For an existing facility, communicate this information to local responders for inclusion in their emergency planning.
- 2) For a proposed new facility, refer to Chapter 9

## CHAPTER 9

### Evaluation Summary for a Proposed New LP-Gas Facility

In this chapter the results of analyses performed in Chapter 4 through Chapter 8 for a proposed (new) LP-Gas facility are summarized. If noncompliance with NFPA 58-2014 is found, the design must be altered to bring the proposed facility into compliance. In some cases, several alternative approaches for complying with the code are presented.

Complete Form 9.1, Form 9.2 and Form 9.3 (and if necessary, Form 9.4 and Form 9.5) and implement any necessary changes to the design to bring the new facility into compliance with the code.

#### Form 9.1

#### Analysis Summary on Product Control and Local Conditions of Hazard

A	B	C	D	E
Item #	CHAPTER Title	Section & Title	Reference FORM #	Number of "No" checked
1	Product Control Measures in Containers & Transfer Piping	5.1: Product Control in Containers	5.1 or 5.2	
		5.2 Product Control in Transfer Piping	5.3	
			5.4	
			5.5	
			5.6	
			5.7	
2	Analysis of Local Conditions of Hazard	6.1 Physical Protection Measures	6.1	
		6.2 Ignition Source Control	6.2	
		6.3.1 Separation distances; Container and outside exposures	6.3	
		6.3.2 Separation distances; Transfer points and outside exposures	6.4	
		6.4 Special Protection Measures	6.5	
			6.6	

§ The number of "No" for Forms from Chapter 5 is the difference between the required number of appurtenances according to NFPA 58-2014, and a lesser number found to be actually installed on the container or the transfer piping.

If, in any row of column E (“No”) of Form 9.1, the entry number is greater than zero, the proposed LP-Gas facility is not in compliance with the requirements of NFPA 58-2014 for product control appurtenances or other safety measures. The design of the proposed facility must be modified to conform to the code requirements. In addition, the following items should be noted.

- If there are any “No” checks in Form 6.3, then the separation distance requirements for containers are not satisfied. An option that may be considered is the reduction in separation distance to 10 feet for underground and mounded containers by providing “Redundant and Fail-Safe Product Control Measures.” In this case, complete Form 9.4 below to ensure that each requirement of “Redundant and Fail-Safe Product Control Measures” is provided.
- If there are any “No” checks in Form 6.4, then the separation distance requirements for transfer points are not satisfied. In this case, relocate the transfer points so that the separation distances conform to the code requirements or provide the Low Emission Transfer Equipment. Complete Form 9.5 below and ensure that all requirements for Low Emission Transfer Equipment are fulfilled.

**Form 9.2**  
**Analysis Summary on Exposure from and to the LP-Gas Facility**

A	B	C	D	E
Item #	CHAPTER Title	Section & Title	Reference FORM #	Number of “Yes” checked
1	Exposure to and from Other Properties	7.1 Exposure to off-site properties and persons from in-plant propane releases	7.1	
		7.2 Exposure to propane facility from external events.	7.2	

If the entry number in column E (“Yes”), Form 9.2 corresponding to Form 7.1 is greater than zero, consider one or more of the following design alternatives.

- 1 Consider moving the container or the transfer point to a different location, if possible and space exists, so that the property or the person is beyond the hazard distance.
- 2 Provide “Redundant and Fail-safe Product Control Measures”. Complete Form 9.4 to ensure compliance.
- 3 Institute other technical measures such as installing gas and flame detectors (connected to facility shut down systems), sounding alarm outside facility premises, etc.
- 4 Institute administrative controls such as additional training for personnel, more frequent inspections of hoses and transfer piping, etc.

If the entry number in column E (“Yes”), Form 9.2 corresponding to Form 7.2 is greater than zero, consider one or more of the following design alternatives.

- 1 Implement procedures to monitor neighboring activity.
- 2 Install means in the adjacent plant to shut down the LP-Gas plant in case of an emergency in that plant.

### Form 9.3 Analysis Summary on Fire Department Evaluations

A	B	C	D	E	F
Item #	CHAPTER Title	Section & Title	Reference FORM #	Number “zeros” entered in Column C, Lines 6 through 8 of Form 8.1	Number of “Yes” checked in Column C of Form 8.4
1	Fire department capability, adequacy of water supply and Emergency Planning	8.1 Data on the Fire Department	8.1		
2		8.2 Fire response water needs and availability	8.4		

If the entry number in row 1, Column E of Form 9.3 is greater than zero, consider one or more of the following design alternatives.

- 1 Discuss with the local Fire Department the needs of the LP-Gas facility and the evaluation results on the capability and training inadequacies of the Department.
- 2 Consider developing a cadre of personnel within the LP-Gas facility to respond to emergencies.
- 3 Institute container special protection system based on active protection approaches or passive approaches. Complete Form 9.6 and Form 9.7 below.

If the entry number in row 2, Column F of Form 9.3 is equal to zero, consider one or more of the following design alternatives.

- 1 Provide special protection (other than water spray or monitor systems) to containers, satisfying the requirements of section 6.27.5 of NFPA 58, 2014 edition. Complete Form 9.6 to ensure compliance.
- 2 Consider implementing the various options indicated in Table 9.1.

**Form 9.4**  
**Redundant and Fail-Safe Design for Containers**

A	B		C	D	E	F
Item #	Description		Features	Proposed for the facility?		NFPA 58 Section Reference (2014 Edition)
				Yes	No	
1	Container sizes for which the appurtenances are provided		Appurtenances and redundant fail-safe equipment are provided for <u>each</u> container of water capacity 2,001 gal through 30,000 gal			6.28.3 and 6.28.4
2	Liquid or vapor withdrawal (1-1/4 in. or larger)		Internal valve having internal excess flow valve			6.28.3.1 and 6.28.3.2
			Positive shutoff valve installed as close as possible to the internal valve			6.28.3.4
3	Liquid or vapor inlet		Internal valve having internal excess flow valve or Backflow check valve			6.28.3.5
			Positive Shutoff Valve installed as close as possible to the Internal Valve or the back flow check valve			6.28.3.5
4	Railcar transfer	Flow into or out of railroad tank car	Emergency shutoff valve installed in the transfer hose or the swivel-type piping at the tank car end.			6.19.2.6 (1) and 6.28.4.1
		Flow only into railroad tank car	Emergency shutoff valve or backflow check valve installed in the transfer hose or the swivel-type piping at the tank car end.			6.19.2.6 (2) and 6.28.4.1
5	Cargo tank transfer		Protection provided in accordance with 6.28.4.1			6.28.4.1
6	Automatic closure of all primary valves (IV & ESV) in an emergency		By thermal (Fire) actuation			6.28.4.2
			Actuated by a hose pull-away due to vehicle motion			6.28.4.2
7	Manually operated remote shutdown of IV and ESV		Remote shutdown station within 15 ft of the point of transfer?			6.28.4.3 (A)
			Another remote shutdown station between 25 ft and 100 ft of the transfer point?			6.28.4.3 (B)
			Shutdown stations will shut down electrical power supply to the transfer equipment and all primary valves (Internal and Emergency Valves)			6.28.4.3
			Signs complying with the requirements of 6.28.4.3 (C) provided?			6.28.4.3 (C)

**Note:** If your facility does not have a rail terminal, write the word NA in both the “Yes” column and the “No” column in item 4 of the form in the railroad tank car row. Similar option is also available if there is no cargo tank vehicle transfer station.

**Form 9.5**  
**Evaluation of Low Emission Transfer Equipment**

A	B	C		D	E	F
Item #	Description	Features		Proposed for the facility?		NFPA 58 Section Reference (2014 Edition)
				Yes	No	
1	Transfer into permanently mounted ASME containers on vehicles	Delivery nozzle and filler valve-max. liquid release after transfer of 4 cm <sup>3</sup> (0.24 in <sup>3</sup> ).	Fixed maximum liquid level gage not used during transfer operations			6.28.5.3 (A) & (B)
2	Transfer into stationary ASME containers delivery valve and nozzle combination	During product transfer or post transfer uncoupling of the hose, liquid product volume released to the atmosphere	Does not exceed 4 cm <sup>3</sup> (0.24 in <sup>3</sup> ) from a hose of nominal size 1 in or smaller			6.28.5.4 (A)
			Does not exceed 15 cm <sup>3</sup> (0.91 in <sup>3</sup> ) from a hose of nominal size larger than 1 in.			6.28.5.4 (B)
3	Transfer into stationary ASME containers maximum filling limit	Do containers less than 2,001 gal (w.c.) have an overfilling prevention device or another approved device?				6.28.5.4 (F)
		Do containers 2,001 gal (w.c.) or greater have a float gage or other non-venting device?				6.28.5.4 (E)
4	Transfer into stationary ASME containers fixed maximum liquid level gage	Not used during routine transfer operations but may be used in calibrating other non-venting liquid level gauges in the container				6.28.5.4 (C) & (D)

**Note:** If the facility does not have a particular feature described in items 2 or 3, write “NA” in both the “Yes” and “No” columns corresponding to its row .

**Form 9.6**  
**Special Protection Measures – Passive Systems**

A Item #	B Special Protection Option	C Question	D		E NFPA 58 Section Reference (2014 Edition)
			Proposed for the facility?		
			Yes	No	
1	Container insulation	Insulation provided on each of the containers?			6.27.5.1
		Insulation material complies with the requirements of NFPA 58?			6.27.5.1 and 6.27.5.2
2	Mounding of containers	Each container in the facility is mounded?			6.27.5.3
		Mounding complies with each requirement under section 6.6.6.3 of NFPA 58.			6.6.6.3 and 6.27.5.3
3	Burying of containers	Each container in the facility is buried?			6.27.5.4
		Buried containers comply with each requirement under section 6.6.6.1 of NFPA 58.			6.6.6.1 and 6.27.5.4

**Form 9.7**  
**Special Protection Measures – Active Systems**

Item #	Special Protection Option	Question	Is the Facility compliant?		NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Water spray systems	Are fixed water spray systems, complying with NFPA 15 requirements, used for each container in the facility?			6.27.6.1
		Do fire responsive devices actuate water spray system automatically?			6.27.6.2
		Can the water spray systems be actuated manually also?			6.27.6.2
2	Monitor nozzle systems	Are the monitor nozzles located and arranged so that the water stream can wet the surfaces of all containers exposed to a fire?			6.27.6.3
		Can the water stream from a monitor nozzle reach and wet the entire surface of, at least, one half of a length from one end of each of the containers it is designed to protect?			6.27.6.3
		Do fixed monitor nozzles comply with NFPA 15 requirements?			6.27.6.1
		Do fire responsive devices actuate the monitor nozzles?			6.27.6.2
		Can the monitor nozzles be actuated manually also?			6.27.6.2

### **Equivalent Protection to a Water Supply for Industrial and Bulk Facilities**

In the case where water supply is not available in or near the LP-Gas facility, or is inadequate or it is prohibitively expensive to connect to a public or private water supply hydrant, alternative methods for providing protection should be considered. In lieu of providing a water supply, several alternatives are indicated in Table 9.1, which can offer an equivalency to a water supply system.

The intent of the controls identified in Table 9.1 is to maintain the entire system as a gas tight entity. These methods include reducing the service life of equipment, increasing the design pressure rating of the system beyond the requirements of NFPA 58, or providing early detection and isolation of the system to ensure product control. This list is not exhaustive and is not ranked in an order of priority.

**Table 9.1  
Suggested Alternative Methods for Industrial and Bulk Plants That Do Not Pose a Hazard But Lack a Water Supply**

Item #	Possible options to implement when adequate water supply is not available
1	Reduce the service life of hoses.
2	Increase frequency of equipment inspection.
3	Establish a service life program for the maintenance of the container pressure relief devices. This could include the installation of a listed multiple port valve and certifying that the relief devices are properly set and maintained every 5 to 10 years.
4	Increase the design strength of the piping and fitting systems.
5	Install emergency shutoff valves in conjunction with container internal valves.
6	Install emergency shutoff valves downstream of transfer pump outlets and upstream of the vapor and liquid valves at the bulkhead.
7	Install pneumatic tubing along the facility boundary to serve as a perimeter fire detection system. This would provide protection of the facility against exposure fires.
8	Provide optical flame detection or linear heat detection, or a gas detection system connected to an isolation valve installed downstream of every liquid and vapor nozzle on the container. This system could also be monitored to send a signal to an alarm company that notifies the fire department of an event.
9	Increase the separation distances of internal facility exposures to the container. These exposures would include a site dumpster, idle or waste pallets and combustibles, and increasing the parking distances between the bobtails and transports in relation to the container.
10	Relocate overhead power lines away from all container and cylinder storage areas to protect against ignition in the event of a line dropping due to wind or power pole impact.
11	Eliminate all combustible vegetation within 30 feet of the LP-Gas container. This can be accomplished using gravel, or paving the site yard.
12	Install tanks using the mounding or burial method.

## **Interactive Appendix A Fill-in Forms (2014 Edition of NFPA 58)**

This Appendix contains a set of forms copied from the different chapters in this manual. The form number corresponds to the respective forms in chapters 4 through 9; the first number digit represents the chapter number. Where the forms refer to a figure, it is understood that they refer to the figures shown in the main body of the manual.

### ***How to Use the Forms in this Section***

This document contains tables with fill-in blanks, or form fields, in which you enter information. These tables are made of cells, and the ones in which you may enter information contain gray shading.

The following types of form fields are included in this Appendix:

**Regular Text:** Accepts text, numbers, symbols, or spaces.

**Number:** Allows a number only. If you enter a letter into this field, it will change to a zero after you leave the field.

**Calculation:** Uses a formula to calculate numbers, such as the sum of two columns, which automatically appears in another column. Users cannot fill in or change this field, even though it contains gray shading. **Users must click in another number field to activate the calculations.**

**Checkbox:** Shows the selection state of an item. When the box is empty, or unchecked, click it to make an X appear. When the box is checked and contains an X, click the box to remove it. Examples: Unchecked:  Checked:

The form fields are already set up to accept only a certain type of input (numbers only or numbers and letters) and contain the formulas needed for automatically performing calculations. Users are not permitted to use the other fields in the forms (for example, change Item #s or values already in the form).

**Form 4.1**  
**Initial Data on the LP-Gas Facility**

A	B	C
Item #	Information Item	Data
1	Name of the LP-Gas Facility Owner or Operator	
2	Contact Name	
3	Contact Telephone & Fax Numbers	
4	Contact Email Address	
5	Mailing Address	Street 1:
		Street 2:
		City, State, Zip:

**Form 4.2**  
**Facility Storage Capacity** <sup>1,2,3,5</sup>

A	B	C	D
Item #	Individual Container Water Capacity (w.c.) (gallons)	Number of containers	Total Water Capacity (w.c.) of each container size (gallons)
1	500		
	1,000		
	2,000		
	4,000		
	10,000		
	18,000		
	30,000		
	60,000		
	Other:		
	Other:		
	Other:		
2	<b>Aggregate Water Capacity<sup>4</sup></b>		

- Notes:**
- (1) Column D = Column B x Column C.
  - (2) Parked bobtails, transports and tank cars should not be considered for aggregate capacity calculations.
  - (3) Do not consider containers that are not connected for use.
  - (4) For the purpose of this manual, "Aggregate Water Capacity" means any group of single ASME storage containers separated from each other by distances less than those stated in the aboveground containers column of Table 6.3.1.
  - (5) **This form contains formulas that will automatically calculate results based on the values entered in the related cells. To activate the calculations, click in another number field, such as one in Column C.**

**If the aggregate water capacity (w.c.) of the LP-Gas facility is less than or equal to 4,000 gallons, no further assessment is required.**

**YOU CAN STOP HERE.**

**Form 4.3**  
**Additional Information on the LP-Gas Facility**

Existing Facility; Built to NFPA 58 Edition \_\_\_\_\_  Proposed Facility

a) Name of the Facility (if applicable): \_\_\_\_\_

b) Type of LP-Gas Facility:  Commercial  Industrial  Bulk Plant

c) Facility is located in:  City Industrial Zone  Suburban Area  Rural Area  
 City Commercial Zone

d) Facility neighbors<sup>§</sup>:  Agri Fields  Commercial Bldgs.  Flammable Liquids Storage  
 (Check all that apply)  Industrial Activity (metal fabrication, cutting and welding, etc.)  
 Manufacturing  Others (explain) \_\_\_\_\_

e) Geographic Location of Facility/Address: \_\_\_\_\_  
 \_\_\_\_\_

f) Landmarks, if any: \_\_\_\_\_  
 \_\_\_\_\_

g) LP-Gas liquid supply by:  Bobtail  Truck Transport  Rail Tank Car  
 (Check all that apply)  Pipeline

h) LP-Gas Distribution by:  Liquid Piping  Truck Transport  Vapor Piping Plant  
 (Check all that apply):  Bobtail  Dispensing or Vehicle Liquid Fueling

i) Number of Vehicle Entrances:  One  Two  More than two

j) Type of Access Roads to the Facility:  Rural  City or Town  Highway  
 (One check per line) Entrance 1:  Dirt road  Gravel road  Paved  
 (One check per line) Entrance 2:  Dirt road  Gravel road  Paved

k) Staff presence:  Not staffed  Only during transfer operations  
 Staffed always (24/7)  Only during business hours  
 Other (Explain) \_\_\_\_\_

l) Location and distances to Assembly, Educational or Institutional Occupancies surrounding the facility, if any, within 250 feet from the facility boundary in the direction of the assets:  
 \_\_\_\_\_  
 \_\_\_\_\_

m) Overview plot plan of the facility attached?  Yes  No

§ All properties either abutting the LP-Gas facility or within 250 feet of the container or transfer point nearest to facility boundary.

**Form 5.1**  
**Compliance with Code Requirements for Appurtenances on Containers of**  
**4,000 Gallons Water Capacity or Less**

A	B	C	D	E
Container #	Service Configuration Subfigure (in Figure 5-1)	Number of Product Control Appurtenances		NFPA 58 Section Reference (2014 edition)
		Required by NFPA 58 (applicable edition)	Installed on the Container	
1				5.7.4.1, Table 5.7.4.1 (B) and 5.7.4.4
2				
3				
4				
5				
6				
7				

**If, in Form 5.1, any one of the numbers in column D is less than the number in Column C of the corresponding row, then these items must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

**Form 5.2**  
**Compliance with Code Requirements for Appurtenances on Containers**  
**Having a Water Capacity Greater Than 4,000 Gallons**

A	B	C	D		E	F	G
Container #	LP-Gas inlet to and outlet from the container**		Enter Configuration Number		Total Number of Product Control Appurtenances		NFPA 58 Section Reference (2014 edition)
					Required by NFPA 58 (applicable edition)	Installed on the container	
1	Vapor	Inlet	5-2				5.7.4.2, Table 5.7.4.2 and 5.7.4.3
		Outlet	5-3				
	Liquid	Inlet	5-6				
		Outlet	5-7				
2	Vapor	Inlet	5-2				
		Outlet	5-3				
	Liquid	Inlet	5-6				
		Outlet	5-7				
3	Vapor	Inlet	5-2				
		Outlet	5-3				
	Liquid	Inlet	5-6				
		Outlet	5-7				
4	Vapor	Inlet	5-2				
		Outlet	5-3				
	Liquid	Inlet	5-6				
		Outlet	5-7				

\*\* If the container does not provide an opening for the specific function listed, enter 0 (zero) in columns E and F corresponding to that row.

**If in Form 5.2 any one of the numbers in column F is less than the number in Column E of the corresponding row, these items must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

**Form 5.3**  
**Requirements for Transfer Lines of 1½-inch Diameter or Larger,**  
**Liquid-into-Containers**

A Item #	B Appurtenance (Either No. 1 or No. 2)**	C Appurtenance Provided with the Feature	D		F NFPA 58 Section Reference (2014 edition)
			E Installed in the facility?		
			Yes	No	
1	Emergency shutoff valve (ESV)  (Ref § 6.12)	Installed within 20 ft. of lineal pipe from the nearest end of the hose or swivel-type connections.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.2
		Automatic shutoff through thermal (fire) actuation element with maximum melting point of 250 °F.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.6
		Temperature-sensitive element (fusible link) installed within 5 ft. from the nearest end of the hose or swivel-type piping connected to liquid transfer line.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.6
		Manually operated remote shutoff feature provided for ESV.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.12.1
		Manual shutoff device provided at a remote location, not less than 25 ft., and not more than 100 ft. from the ESV in the path of egress.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.12.2
		An ESV is installed on each leg of a multi-leg piping each of which is connected to a hose or a swivel-type connection on one side and to a header of 1½ inch in diameter or larger on the other side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.5 and 6.19.2.6 (1)
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.8
2	Backflow check valve (BCK)**	Installed downstream of the hose or swivel-type connection.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.3
		BCK is designed for this specific application.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.4
		A BCK is installed on each leg of a multi-leg piping each of which is connected to a hose or a swivel type connection on one side and to a header of 1½ inch in diameter or larger on the other side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.5
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.8
3	Debris protection ++	Liquid inlet piping is designed or equipped to prevent debris and foreign material from entering the system.	<input type="checkbox"/>	<input type="checkbox"/>	6.19.2.5
4	Emergency discharge control	Flow-through facility hose used to transfer LP-Gas from non-metered cargo tank vehicle into containers will stop within 20 seconds of a complete hose separation without human intervention.	<input type="checkbox"/>	<input type="checkbox"/>	6.19.2.6 (3)

\*\* In lieu of an emergency shutoff valve, the backflow check valve (BCK) is only permitted when flow is only into the container and shall have a metal-to-metal seat or a primary resilient seat with metal backup, not hinged with a combustible material (6.12.3, 6.12.4).

++ Retrofit required for existing facilities by July 1, 2011.

**Form 5.4**  
**Requirements for Transfer Lines of 1½-inch Diameter or Larger,**  
**Liquid Withdrawal from Containers**

A	B	C	D	E	F
Item #	Appurtenance	Appurtenance Provided with the Feature	Installed in the facility?		NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Emergency shutoff valve (ESV) (Ref § 6.12)	Installed within 20 ft. of lineal pipe from the nearest end of the hose or swivel-type connections.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.2
		Automatic shutoff through thermal (fire) actuation element with maximum melting point of 250 °F.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.6
		Temperature-sensitive element installed within 5 ft. from the nearest end of the hose or swivel-type piping connected to liquid transfer line.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.6
		Manually operated remote shutoff feature provided for ESV.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.12.1
		Manual shutoff device provided at a remote location, not less than 25 ft., and not more than 100 ft. from the ESV in the path of egress.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.12.2
		An ESV is installed on each leg of a multi-leg piping each of which is connected to a hose or a swivel-type connection on one side and to a header of 1½ inch in diameter or larger on the other side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.5 and 6.19.2.6 (1)
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.8
<b>Number of ESV's in liquid withdrawal service</b>					

Note: If more than one ESV is installed in the facility, use one Form 5.4 for each ESV.

## Form 5.5

### Requirements for Vapor Transfer Lines 1¼-inch Diameter or Larger

A	B	C	D	E	F
Item #	Appurtenance	Appurtenance Provided with the Feature	Installed in the facility?		NFPA 58 Section Reference (2014 edition)
			Yes	No	
1	Emergency shutoff valve (ESV) (Ref § 6.12)	Installed within 20 ft. of lineal pipe from the nearest end of the hose or swivel-type connections.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.2
		Automatic shutoff through thermal (fire) actuation element with maximum melting point of 250 °F.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.6
		Temperature-sensitive element installed within 5 ft. from the nearest end of the hose or swivel-type piping connected to liquid transfer line.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.6
		Manually operated remote shutoff feature provided for ESV.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.12.1
		Manual shutoff device provided at a remote location, not less than 25 ft., and not more than 100 ft. from the ESV in the path of egress.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.12.2
		An ESV is installed on each leg of a multi-leg piping each of which is connected to a hose or a swivel-type connection on one side and to a header of 1-1/4 inch in diameter or larger on the other side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.5 and 6.19.2.6 (1)
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.8
2	Backflow check valve (BCK)**	Installed downstream of the hose or swivel-type connection.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.3
		BCK is designed for this specific application.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.4
		A BCK is installed on each leg of a multi-leg piping each of which is connected to a hose or a swivel-type connection on one side and to a header of 1-1/4 inch in diameter or larger on the other side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.5
		Breakaway protection is provided such that in any pull-away break will occur on the hose or swivel-type connection side while retaining intact the valves and piping on the plant side.	<input type="checkbox"/>	<input type="checkbox"/>	6.12.8

\*\* In lieu of an emergency shutoff valve, the backflow check valve (BCK) is only permitted when flow is only into the container and it shall have a metal-to-metal seat or a primary resilient seat with metal backup, not hinged with a combustible material (6.12.3, 6.12.4).

**If a check mark is made in the “No” column of any one of Form 5.3, Form 5.4 or Form 5.5, then these items must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

**If the LP-Gas facility is designed using ALTERNATE PROVISIONS for the installation of ASME CONTAINERS, then continue the analysis below. Otherwise skip Section 5.3 and go to Chapter 6.**

## Form 5.6

### Evaluation of Redundant Fail-Safe Design

A	B		C	D	E	F
Item #	Description		Features	Installed in the facility?		NFPA 58 Section Reference (2014 edition)
				Yes	No	
1	Container sizes for which the appurtenances are provided		Appurtenances and redundant fail-safe equipment are provided for <u>each</u> container of water capacity 2,001 gal. through 30,000 gal.	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3 and 6.28.4
2	Liquid or vapor withdrawal (1-1/4 in. or larger)		Internal valve having internal excess-flow valve	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.1 and 6.28.3.2
			Positive shutoff valve installed as close as practical to the internal valve	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.4
3	Liquid or vapor inlet		Internal valve having internal excess-flow valve or backflow check valve (BCK)	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.5
			Positive shutoff valve installed as close as possible to the internal valve or the backflow check valve (BCK)	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.5
4	Railcar transfer	Flow into or out of railroad tank car	Approved emergency shutoff valves installed in the transfer hose or the swivel-type piping at the tank car end	<input type="checkbox"/>	<input type="checkbox"/>	6.19.2.6 (1) and 6.28.4
		Flow only into railroad tank car	Approved emergency shutoff valve or back-flow check valve (BCK) installed in the transfer hose or the swivel-type piping at the tank car end	<input type="checkbox"/>	<input type="checkbox"/>	6.19.2.6 (2) and 6.28.4
5	Cargo tank transfer		Protection provided in accordance with 6.12	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.1
6	Automatic closure of all primary valves (IV & ESV) in an emergency		By thermal (fire) actuation	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.2
			Actuated by a hose pull-away due to vehicle motion	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.2
7	Manually operated remote shutdown of IV and ESV		Remote shutdown station within 15 ft. of the point of transfer	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3 (A)
			Another remote shutdown station between 25 ft. and 100 ft. of the transfer point	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3 (B)
			Shutdown stations will shut down electrical power supply to the transfer equipment and shut down all primary valves (internal & emergency valves).	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3
			Signs complying with the requirements of 6.28.4.3 (C) provided	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3 (C)

**Note:** If the facility does not have a rail terminal, write "NA" in both the "Yes" column and the "No" column in item 4 of this Form in the railroad tank car row. Similar option is also available if there is no cargo tank vehicle transfer station.

**If the LP-Gas facility is provided with LOW EMISSION TRANSFER EQUIPMENT, then continue the analysis below. Otherwise skip section 5.3.2 and go to Chapter 6.**

**Form 5.7  
Evaluation of Low Emission Transfer Equipment**

A I t e m #	B Description	C Features		D Installed in the facility?		F NFPA 58 Section Reference (2014 Edition)
				Yes	No	
1	Transfer into permanently mounted ASME containers on vehicles	Delivery nozzle and filler valve - Max. liquid release after transfer of 4 cm <sup>3</sup> (0.24 in <sup>3</sup> )	Fixed maximum liquid level gauge not used during transfer operations	<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.3 (A) and (B)
2	Transfer into stationary ASME containers delivery valve and nozzle combination	During product transfer or post transfer uncoupling of the hose, liquid product volume released to the atmosphere	Does not exceed 4 cm <sup>3</sup> (0.24 in <sup>3</sup> ) from a hose of nominal size 1 inch or smaller	<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (A)
			Does not exceed 15 cm <sup>3</sup> (0.91 in <sup>3</sup> ) from a hose of nominal size larger than 1 inch	<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (B)
3	Transfer into stationary ASME containers maximum filling limit	Do containers of less than 2,001 gal (w.c.) have an overfilling prevention device or another approved device?		<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (F)
		Do containers 2,001 gal (w.c.) or greater have a float gauge or other non-venting device?		<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (E)
4	Transfer into stationary ASME containers fixed maximum liquid level gauge	Not used during routine transfer operations but used to calibrate other non-venting liquid level gauges in the container		<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (C) and (D)

**Note:** 1) If the facility does not have a particular feature described in items 2 or 3, write "NA" in both the "Yes" and "No" columns corresponding to its row.

**If separation distance reductions are intended, check marks made in the "No" column of either Form 5.6 or Form 5.7 must be addressed and brought into compliance with the specific edition of NFPA 58 that the facility was constructed to.**

## Form 6.1

### Evaluation of Physical Protection and Other Measures

A	B	C	D	E	F
#	Item	Features	Installed in the facility?		NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Lighting <sup>‡</sup>	Provide lighting for nighttime operations to illuminate storage containers, container being loaded, control valves, and other equipment	<input type="checkbox"/>	<input type="checkbox"/>	6.19.5
2	Vehicle impact protection	Protection against vehicular (traffic) impacts on containers, transfer piping and other appurtenances is designed and provided commensurate with the size of vehicles and type of traffic in the facility. Example protection systems include but not limited to (1) Guard rails, (2) Steel bollards or crash posts, (3) Raised sidewalks.	<input type="checkbox"/>	<input type="checkbox"/>	6.6.1.2 and 6.9.3.10
3	Protection against corrosion	Provide protection against corrosion where piping is in contact with supports or corrosion-causing substances.	<input type="checkbox"/>	<input type="checkbox"/>	6.9.3.11, 6.9.3.14 and 6.17
<b>Complete only 4A or 4B</b>					
4A	Perimeter Fence	Is an industrial type or chain link fence of at least 6 ft. high or equivalent protection provided to enclose (all around) container appurtenances, pumping equipment, loading and unloading and container filling facilities?	<input type="checkbox"/>	<input type="checkbox"/>	6.19.4.2
		Are at least two means of emergency accesses (gates) from the enclosure provided? <b>NOTE: Write “NA” (not applicable) if:</b> (i) The area enclosed is less than 100 ft <sup>2</sup> , or (ii) The point of transfer is within 3 ft. of the gate, or containers are not filled within the enclosure	<input type="checkbox"/>	<input type="checkbox"/>	6.19.4.2 (A)
		Is a clearance of at least 3 ft. all around to allow emergency access to the required means of egress provided?	<input type="checkbox"/>	<input type="checkbox"/>	6.19.4.2 (B)
	Guard Service	If a guard service is provided, does this service cover the LP-Gas plant and are the guard personnel provided with appropriate LP-Gas related training, per section 4.4 of NFPA 58?	<input type="checkbox"/>	<input type="checkbox"/>	6.19.4.3
<b>Complete only 4A or 4B</b>					
4B	Lock-in-Place devices	Are Lock-in-Place devices provided to prevent unauthorized use or operation of any container appurtenance, system valves, or equipment in lieu of the fence requirements above?	<input type="checkbox"/>	<input type="checkbox"/>	6.19.4.2 (C)

**Note:** Fill only items 1, 2, 3, and 4A or 4B. Indicate with “NA” when not filling the “Yes” or “No” column.

<sup>‡</sup> Indicate with “NA” if the facility is not operated at night.

**Form 6.2**  
**Assessment of Sources of Ignition and Adjacent Combustible Materials**

A	B	C	D	E
#	Sources of Ignition and Requirements Pertaining to Adjacent Combustible Materials	Is the Facility compliant?		NFPA 58 Section Reference (2014 Edition)
		Yes	No	
1	Are combustible materials not closer than 10 ft. from each container?	<input type="checkbox"/>	<input type="checkbox"/>	6.4.4.3
2	Is a distance at least 20 ft. provided between containers and tanks containing flammable liquids with flash point less than 200 °F (e.g., gasoline, diesel)?	<input type="checkbox"/>	<input type="checkbox"/>	6.4.4.6
3	Are electrical equipment and wiring installed per Code requirements?	<input type="checkbox"/>	<input type="checkbox"/>	6.23.2
4	Is open flame equipment located and used according to Code?	<input type="checkbox"/>	<input type="checkbox"/>	6.23.3.1
5	Are ignition control procedures and requirements during liquid transfer operations complied with?	<input type="checkbox"/>	<input type="checkbox"/>	7.2.3.2
6	Is an approved, portable, dry chemical fire extinguisher of minimum capacity 18 lbs. and having a B:C rating provided in the facility?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.4.2
7	Is an approved, portable, dry chemical fire extinguisher of minimum capacity 18 lbs. and having a B:C rating provided on each truck or trailer used to transport portable containers?	<input type="checkbox"/>	<input type="checkbox"/>	9.3.5 and 9.4.7
8	Is the prohibition on smoking within the facility premises strictly enforced?	<input type="checkbox"/>	<input type="checkbox"/>	7.2.3.2 (B) and 9.4.10

**Note:** Insert "NA" in both "Yes" and "No" columns of any items that are not applicable.

### Form 6.3

## Separation Distances from Containers to Buildings, Property Lines that can be Built upon, Inter-container Distances, and Aboveground Flammable or Combustible Storage Tanks

A #	B Container Size Range in gal (W.C.)	C Separation between a property line, important building or other property and the <u>nearest</u> container which is	D Minimum Distance (ft.)	E Is the Facility compliant?		G NFPA 58 Section Reference (2014 Edition)	
				Yes	No		
1	501 through 2,000	Above Ground	25	<input type="checkbox"/>	<input type="checkbox"/>	6.3.1, 6.3.2 and Table 6.3.1.1	
		Underground or Mounded	10	<input type="checkbox"/>	<input type="checkbox"/>		
		Between containers	3	<input type="checkbox"/>	<input type="checkbox"/>		
2	2,001 through 30,000	Above Ground	50	<input type="checkbox"/>	<input type="checkbox"/>		
		Underground or Mounded	50	<input type="checkbox"/>	<input type="checkbox"/>		
		Between containers	5	<input type="checkbox"/>	<input type="checkbox"/>		
3	30,001 through 70,000	Above Ground	75	<input type="checkbox"/>	<input type="checkbox"/>		
		Underground or Mounded	50	<input type="checkbox"/>	<input type="checkbox"/>		
		Between containers	¼ sum of diameters of adjacent containers	<input type="checkbox"/>	<input type="checkbox"/>		
4	70,001 through 90,000	Above Ground	100	<input type="checkbox"/>	<input type="checkbox"/>		
		Underground or Mounded	50	<input type="checkbox"/>	<input type="checkbox"/>		
		Between containers	¼ sum of diameters of adjacent containers	<input type="checkbox"/>	<input type="checkbox"/>		
5	All sizes greater than 125 gal	Separation distance between a LP-Gas container and an above ground storage tank containing flammable or combustible liquids of flash points below 200 °F.	20	<input type="checkbox"/>	<input type="checkbox"/>		6.4.4.6 and 6.4.4.7

**Note:** If any of the container sizes indicated in the above form are not present in the facility, enter "NA" in both Yes and No columns.

**If the LP-Gas plant is provided with every one of the redundant and fail-safe product control-design equipment indicated in Form 5.6, then the minimum distance in column D of Form 6.3 can be reduced to 10 feet for underground and mounded containers of water capacity 2,001 gal to 30,000 gal.**

## Form 6.4

### Separation Distances between Points of Transfer and other Exposures

A	B		C	D	E		F	G	
#	Type of Exposure within or outside the facility boundary		Check if exposure is present	Minimum Distance (ft)	Is the Facility compliant?		Yes	No	NFPA 58 Section Reference (2014 Edition)
					Yes	No			
1	Buildings, mobile homes, recreational vehicles, and modular homes with at least 1-hour fire-rated walls		<input type="checkbox"/>	10	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	6.5.2 and Table 6.5.2.1
2	Buildings with other than at least 1-hour fire-rated walls		<input type="checkbox"/>	25	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
3	Building wall openings or pits at or below the level of the point of transfer		<input type="checkbox"/>	25	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
4	Line of adjoining property that can be built upon		<input type="checkbox"/>	25	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
5	Outdoor places of public assembly, including school yards, athletic fields, and playgrounds		<input type="checkbox"/>	50	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6	Public ways, including public streets, highways, thoroughfares, and sidewalks	From points of transfer in LP-Gas dispensing stations and at vehicle fuel dispensers	<input type="checkbox"/>	10	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
		From other points of transfer	<input type="checkbox"/>	25	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
7	Driveways		<input type="checkbox"/>	5	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
8	Mainline railroad track centerlines		<input type="checkbox"/>	25	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
9	Containers other than those being filled		<input type="checkbox"/>	10	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
10	Flammable and Class II combustible liquid dispensers and the fill connections of non-stationary containers		<input type="checkbox"/>	10	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
11	Flammable and Class II combustible liquid aboveground containers and filling connections of underground containers		<input type="checkbox"/>	20	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
12	LP-Gas dispensing device located close to a Class I liquid dispensing device		<input type="checkbox"/>	10	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	6.25.4.3

**NOTE:** Place a check mark in column C against an exposure that is present in or around the facility. Fill columns E or F for only those rows for which there is a check mark in column C.

**If the facility contains low emission transfer equipment (i.e., all equipment identified in Form 5.7 are installed and are in working order), then the minimum separation distances in column D of Form 6.4 can be reduced to one half of the indicated values.**

**If the containers in the LP-Gas facility are provided with SPECIAL PROTECTION MEASURES, then continue the analysis below. Otherwise skip Forms 6.5 and 6.6 and go to Form 6.7. Also see Chapter 9.**

## Form 6.5 Special Protection Measures – Passive Systems

A #	B Special Protection Option	C Question	D Is the Facility compliant?		E NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Container Insulation	Insulation provided on each of the containers?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.5.1
		Insulation material complies with the requirements of NFPA 58?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.5.1 and 6.27.5.2
2	Mounding of containers	Each container in the facility is mounded?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.5.3
		Mounding complies with each requirement under section 6.6.6.3 of NFPA 58?	<input type="checkbox"/>	<input type="checkbox"/>	6.6.6.3 and 6.27.5.3
3	Burying of containers	Each container in the facility is buried?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.5.4
		Buried containers comply with each requirement under section 6.6.6.1 of NFPA 58.	<input type="checkbox"/>	<input type="checkbox"/>	6.6.6.1 and 6.27.5.4

## Form 6.6 Special Protection Measures – Active Systems

#	Special Protection Option	Question	Is the Facility compliant?		NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Water spray systems	Are fixed water spray systems, complying with NFPA 15 <sup>1</sup> requirements, used for each container in the facility?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.1
		Do fire responsive devices actuate water spray system automatically?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2
		Can the water spray systems be actuated manually also?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2
2	Monitor nozzle systems	Are the monitor nozzles located and arranged so that the water stream can wet the surfaces of all containers exposed to a fire?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.3
		Can the water stream from a monitor nozzle reach and wet the entire surface of, at least, one half of a length from one end of each of the containers it is designed to protect?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.3
		Do fixed monitor nozzles comply with NFPA 15 <sup>1</sup> requirements?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.1
		Do fire responsive devices actuate the monitor nozzles?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2
		Can the monitor nozzles be actuated manually also?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2

1. See discussion in Section 8.2.

2. Refer to Chapter 8 for a discussion on NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*.

**Form 6.7**  
**Protection Against Vehicular Impact**

#	System Protected	Is physical protection provided?		Type of physical protection installed	NFPA 58 Section Reference (2014 Edition)
		Yes	No		
1	Storage containers	<input type="checkbox"/>	<input type="checkbox"/>		6.6.1.2, 6.6.6.1(B), 6.6.6.1(C), 6.9.3.10 and 6.25.3.13
2	Transfer stations	<input type="checkbox"/>	<input type="checkbox"/>		
3	Entryway into plant	<input type="checkbox"/>	<input type="checkbox"/>		

**Table 7.1**

**Distances to Various Types of Propane Hazards Under Different Release Models\*\***

Model #	Details of the Propane Release Model Releases from or due to	Vapor Dispersion Distance to LFL (ft.)	Explosion Hazard Distance (ft.)	Fire Ball Radiation Distance (ft.)	
1a	Bobtail hose failure. Release of the entire inventory in the hose, quickly.	1" ID x 150 ft. hose length	250	110	50
1b		1" ID x 120 ft. hose length	230	103	45
1c		1" ID x 75 ft. hose length	190	90	40
2a	Release of the inventory in a transfer piping 1" x 30 ft. + @ 20 gpm for 10 minutes, due to failed excess flow valve.	135	120	25	
2b	Release of the inventory in a transfer piping 2" x 30 ft. + @ 80 gpm for 10 minutes.	230	252	48	
2c	Release of the inventory in a transfer piping 2" x 80 ft. + @ 70 gpm for 10 minutes.	328	235	74	
2d	Release of the inventory in a transfer piping 2.5" x 30 ft. + @ 80 gpm for 10 minutes.	269	252	59	
2e	Release of the inventory in a transfer piping 3" x 30 ft. + @ 100 gpm for 10 mins.	312	287	69	
2f	Release of the inventory in a transfer piping 3" x 18 ft. + @ 100 gpm for 10 minutes.	256	284	55	
2g	Release of the inventory in a transfer piping 3" x 80 ft. + @ 100 gpm for 10 minutes.	455	284	106	
2h	Release of the inventory in a transfer piping 4" x 30 ft. + @ 200 gpm for 10 minutes.	407	410	89	
3	Release from the container pressure relief valve.	No ignitable vapor concentration at ground level.			
4	Release from a 1" ID x 150 ft. transfer piping to a vaporizer and reduced flow from a partially open excess flow valve @ 20 gpm for 10 minutes.	250	120	50	
5	Leak from a corrosion hole in a transfer pipe at a back pressure of 130 psig (corresponding to 80°F) for 60 minutes. Hole size is ¼" ID.	110	120	5	
6a	Release of the entire inventory in a 2" ID x 20 ft. transfer hose.	195	90	40	
6b	Release of the entire inventory in a 2.5" ID x 16 ft. transfer hose.	215	98	45	
6c	Release of the entire inventory in a 3" ID x 12 ft. transfer hose.	230	100	46	
6d	Release of the entire inventory in a 1.25" ID x 20 ft. transfer hose.	138	66	27	
7a	Transport hose blow down: Hose size 2" ID, 20 ft. length release for 3 minutes, from a transport after the tank is filled.	25	30	<5	
7b	Transport hose blow down: Hose size 2.5" ID, 16 ft. length release for 3 minutes, from a transport after the tank is filled.	25	29	<5	
7c	Transport hose blow down: Hose size 3" ID, 16 ft. length release for 3 minutes, from a transport after the tank is filled.	31	36	<5	

\*\* Results from models described in Appendix B.

## Form 7.1

### Types of Occupancies<sup>(1)</sup> Near or Surrounding the LP-Gas Facility

Type of Occupancies	Model # from Table 7.1	Hazard Distance <sup>(2)</sup> (feet)	Is Occupancy located within the hazard distance from the Facility?	
			Yes	No
<b>Assembly Occupancies</b> (Places of worship, Libraries, Theaters and Auditoriums, Food or Drink Bars, Sports Stadiums, Amusement Parks, Transportation Centers, etc., with 50 or more people).				
<b>Institutional Occupancies</b> (Elderly Persons' Homes or Nursing Homes, Hospitals, Alcohol & Drug Rehabilitation Centers, Prisons).				
<b>Educational Occupancies</b> (Elementary Schools, Day Care facilities, etc.).				

**NOTES:** (1) Different types of occupancies are defined in NFPA 5000.

- (2) Table 7.1 provides a number of scenarios that can result in propane release, and the resulting area exposed, for different ignition mechanisms. Determine the scenarios that are applicable to the facility, for the quantities that can be released, and enter the greatest value from Table 7.1. Use the hose diameters and length that will be used at the facility if they differ from the ones in Table 7.1 and recalculate the hazard distances using a spreadsheet method that is available at [npga.org](http://npga.org). Some scenarios may not be applicable to an installation because of other mitigation measures implemented, such as a hose management procedure to minimize the possibility of hose failure.

**Form 7.2**  
**Exposure to LP-Gas Facility from External Hazards**

A	B	C	D
Item #	Type of Neighboring Operation	Hazard exists to the LP-Gas Facility	
		Yes	No
1	Petroleum and other hazardous material storage, wholesale dispensing, etc.	<input type="checkbox"/>	<input type="checkbox"/>
2	Metal cutting, welding, and metal fabrication	<input type="checkbox"/>	<input type="checkbox"/>
3	Industrial manufacturing that can pose external hazards	<input type="checkbox"/>	<input type="checkbox"/>
4	Ports, rail yards and trans-shipment terminals handling flammable and explosive materials	<input type="checkbox"/>	<input type="checkbox"/>
5	Other operations that may pose hazards (gasoline and other hazardous material dispensing stations, fertilizer storage, etc.)	<input type="checkbox"/>	<input type="checkbox"/>

**Note:** If a particular activity indicated in column B does not exist, fill both "Yes" and "No" columns with "NA."

**Where a "Yes" has been checked in either Form 7.1 or Form 7.2:**

- 1. For an existing facility, communicate this information to local emergency responders for inclusion in their emergency planning.**
- 2. For a proposed facility, implement the actions indicated in Chapter 9.**

**Form 8.1**  
**Data on the Responding Fire Department**

A	B		C
Item #	Data Item		Data Entry
1	Name of the Fire Department (FD).		
2A	Name of the person in the FD assisting with the data acquisition.		
2B	Position of the person in the FD assisting with the data acquisition.		
3A	Date on which FD data was collected.		
3B	Name of the person collecting the data.		
4	Number of firefighters on duty at any time.		
5	Average number of firefighters available for response.		
6A	Number of firefighters qualified to:	“Firefighter I” level.	
6B		“Firefighter II” level.	
7A	Number of firefighters who would:	Respond on the first alarm to the facility.	
7B		Respond on the first alarm and who are qualified to the operations level requirements of NFPA 472 or <u>similar</u> local requirements.	
7C		Respond on the first alarm with specific knowledge and training on the properties of LP-Gas and LP-Gas fires.	
8A	Number of fire apparatus that have the capability to deploy a 125 gpm hose line supplied by onboard water for at least 4 minutes, and, which:	Are in service in the department.	
8B		Would respond on a first alarm.	

**Form 8.2**  
**Response Time Data for the Fire Departments**

A	B	C	D	E
Company or Department	Time in Minutes for			
	Alarm Receipt & Handling	Turnout	Travel	Total Time

**Note:** Number in Column E = Sum of numbers from Columns B through D.

**Form 8.3**  
**Water Flow Rate and Total Water Volume**  
**Required to Cool Containers Exposed to a Fire**

A	B	C	D	E	F	G	H
Item #	ASME Container Size (gallons)	Total Surface Area of each Container <sup>1</sup> (ft <sup>2</sup> )	Surface Area of each container to be Cooled (ft <sup>2</sup> )	Water flow rate required per container (gpm)	Number of containers of the size indicated‡	Total Water flow rate required (gpm)	Total volume of water required for 10 min (gal)
1	500	86	43	10.8			
	1,000	172	86	21.5			
	2,000	290	145	36.3			
	4,000	374	187	46.8			
	6,500	570	285	71.3			
	9,200	790	395	98.8			
	12,000	990	495	123.8			
	18,000	1,160	580	145			
	30,000	1,610	805	201.3			
	45,000	2,366	1,183	295.8			
	60,000	3,090	1,545	386.3			
90,000	4,600	2,300	575				
	Other Size						
2a	Calculated water flow rate for container protection						
2b	Water flow rate rounded up to nearest multiple of 125						
3	Water for firefighter protection, if required						
4	Total water flow rate and volume						

**Note:** Column D = (1/2) x Column C  
Column E = 0.25 (gpm/ft<sup>2</sup>) x Column D;  
Column G = Column F x Column E  
Column H = 10 x Column G  
Line 2a, Column G and Column H are the sum of numbers in each row above line 2 of each column.  
Line 4, Column G and Column H are the sum of numbers in rows 2b and 3.

‡ Consider only three containers for water supply evaluations even if the number of containers in a group is more than three. See Section 8.2.

1 ASME container approximate dimensions.

**The total water requirement for the facility is indicated in item 4, column G (water flow rate) and column H (total water volume or quantity) of Form 8.3. If multiple groups of containers are present in the facility, repeat the calculations in Form 8.3 for each group of containers. The total water requirement for the facility is the largest value for any single group of containers.**

**Form 8.4**  
**Evaluation of Water Availability in or Near the LP-Gas Facility**

A	B	C	D		
Item #	Water from...	Available?	Quantitative information		
1	Public supply or from another piped-in supply through one or more fire hydrants in or near the facility.	<input type="checkbox"/> Yes <input type="checkbox"/> No	Hydrant data	Distance from Container(s) on which water will be applied (feet)	Available water flow rate from all hydrants <sup>1</sup> (gpm)
			Hydrant 1		
			Hydrant 2		
			Hydrant 3		
2	A nearby static water source (stream, pond, lake, etc.).	<input type="checkbox"/> Yes <input type="checkbox"/> No	Distance to water source = ____ feet Time to set up relay = ____ minutes Rate of delivery = ____ gpm		
3	Only through mobile water tanker shuttle.	<input type="checkbox"/> Yes <input type="checkbox"/> No	Time to set up shuttle = ____ minutes Sustainable flow rate = ____ gpm		

<sup>1</sup> Obtain the available flow rate from the local municipal water authority or the entity that supplies water to the hydrant or conduct a test to determine total available flow rate.

- 1. For an existing facility, communicate this information to local responders for inclusion in their emergency planning.**
- 2. For a proposed new facility, refer to Chapter 9.**

## Form 9.1

### Analysis Summary on Product Control and Local Conditions of Hazard

A	B	C	D	E
Item #	Chapter Title	Section & Title	Reference Form #	Number of "No" checked
1	Product Control Measures in Containers & Transfer Piping	5.1 Product Control in Containers	5.1 or 5.2 <sup>§</sup>	
		5.2 Product Control in Transfer Piping	5.3	
			5.4	
			5.5	
			5.6	
			5.7	
2	Analysis of Local Conditions of Hazard	6.1 Physical Protection Measures	6.1	
		6.2 Ignition Source Control	6.2	
		6.3.1 Separation distances; Container and outside exposures	6.3	
		6.3.2 Separation distances; Transfer points and outside exposures	6.4	
		6.4 Special Protection Measures	6.5	
			6.6	

§ The number of "No" for Forms from Chapter 5 is the difference between the required number of appurtenances according to NFPA 58-2011, and a lesser number found to be actually installed on the container or the transfer piping.

**If, in any row of column E ("No") of Form 9.1, the entry number is greater than zero, the proposed LP-Gas facility is not in compliance with the requirements of NFPA 58-2014 for product control appurtenances or other safety measures. The design of the proposed facility must be modified to conform to the code requirements. In addition, the following items should be noted.**

- **If there are any "No" checks in Form 6.3, then the separation distance requirements for containers are not satisfied. An option that may be considered is the reduction in separation distance to 10 feet for underground and mounded containers by providing "Redundant and Fail-Safe Product Control Measures." In this case, complete Form 9.4 below to ensure that each requirement of "Redundant and Fail-Safe Product Control Measures" is provided.**
- **If there are any "No" checks in Form 6.4, then the separation distance requirements for transfer points are not satisfied. In this case, relocate the transfer points so that the separation distances conform to the code requirements or provide the Low Emission Transfer Equipment. Complete Form 9.5 below and ensure that all requirements for Low Emission Transfer Equipment are fulfilled.**

**Form 9.2**  
**Analysis Summary on Exposure from and to the LP-Gas Facility**

A	B	C	D	E
Item #	Chapter Title	Section & Title	Reference Form #	Number of "Yes" checked
1	Exposure to and from Other Properties	7.1 Exposure to off-site properties and persons from in-plant propane releases	7.1	
		7.2 Exposure to propane facility from external events	7.2	

**If the entry number in column E ("Yes"), Form 9.2 corresponding to Form 7.1 is greater than zero, consider one or more of the following design alternatives:**

- 1. Consider moving the container or the transfer point to a different location, if possible and space exists, so that the property or the person is beyond the hazard distance.**
- 2. Provide "Redundant and Fail-safe Product Control Measures." Complete Form 9.4 to ensure compliance.**
- 3. Institute other technical measures such as installing gas and flame detectors (connected to facility shutdown systems), sounding alarm outside facility premises, etc.**
- 4. Institute administrative controls such as additional training for personnel, more frequent inspections of hoses and transfer piping, etc.**

**If the entry number in column E ("Yes"), Form 9.2 corresponding to Form 7.2 is greater than zero, consider one or more of the following design alternatives:**

- 1. Implement procedures to monitor neighboring activity.**
- 2. Install means in the adjacent plant to shut down the LP-Gas plant in case of an emergency in that plant.**

**Form 9.3**  
**Analysis Summary on Fire Department Evaluations**

A	B	C	D	E	F
Item #	Chapter Title	Section & Title	Reference Form #	Number “zeros” entered in Column C, Lines 6 through 8 of Form 8.1	Number of “Yes” checked in Column C of Form 8.4
1	Fire department capability, adequacy of water supply and Emergency Planning	8.1 Data on the Fire Department	8.1		
2		8.2 Fire response water needs and availability	8.4		

**If the entry number in row 1, Column E of Form 9.3 is greater than zero, consider one or more of the following design alternatives:**

- 1. Discuss with the local Fire Department the needs of the LP-Gas facility and the evaluation results on the capability and training inadequacies of the Department.**
- 2. Consider developing a cadre of personnel within the LP-Gas facility to respond to emergencies.**
- 3. Institute container special protection system based on active protection approaches or passive approaches. Complete Form 9.6 and Form 9.7 below.**

**If the entry number in row 2, Column F of Form 9.3 is equal to zero, consider one or more of the following design alternatives:**

- 1. Provide special protection (other than water spray or monitor systems) to containers, satisfying the requirements of section 6.27.5 of NFPA 58, 2014 edition. Complete Form 9.6 to ensure compliance.**
- 2. Consider implementing the various options indicated in Table 9.1.**

## Form 9.4 Redundant and Fail-Safe Design for Containers

A	B		C	D	E	F
Item #	Description		Features	Proposed for the facility?		NFPA 58 Section Reference (2014 Edition)
				Yes	No	
1	Container sizes for which the appurtenances are provided		Appurtenances, redundant fail-safe equipment and low emission transfer lines are provided for <u>each</u> container of water capacity 2,001 gal to 30,000 gal.	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3 and 6.28.4
2	Liquid or vapor withdrawal (1-1/4 in. or larger)		Internal valve with internal excess-flow valve.	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.1 and 6.28.3.2
			Positive shutoff valve installed as close as possible to the internal valve.	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.4
3	Liquid or vapor inlet		Internal valve with internal excess flow valve or backflow check valve (BCK).	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.5
			Positive shutoff valve installed as close as possible to the internal valve or the backflow check valve (BCK).	<input type="checkbox"/>	<input type="checkbox"/>	6.28.3.5
4	Railcar transfer	Flow into or out of railroad tank car	Emergency shutoff valve installed in the transfer hose or the swivel-type piping at the tank car end.	<input type="checkbox"/>	<input type="checkbox"/>	6.19.2.6 (1) and 6.28.4.1
		Flow only into railroad tank car	Emergency shutoff valve or backflow check valve (BCK) installed in the transfer hose or the swivel-type piping at the tank car end.	<input type="checkbox"/>	<input type="checkbox"/>	6.19.2.6 (2) and 6.28.4.1
5	Cargo tank transfer		Protection provided in accordance with 6.28.4.1.	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.1
6	Automatic closure of all primary valves (IV & ESV) in an emergency		By thermal (fire) actuation.	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.2
			Actuated by a hose pull-away due to vehicle motion.	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.2
7	Manually operated remote shutdown of IV and ESV		Remote shutdown station within 15 ft. of the point of transfer?	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3 (A)
			Another remote shutdown station between 25 ft. and 100 ft. of the transfer point?	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3 (B)
			Shutdown stations will shut down electrical power supply to the transfer equipment and all primary valves (Internal and Emergency Valves).	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3
			Signs complying with the requirements of 6.28.4.3 (C) provided?	<input type="checkbox"/>	<input type="checkbox"/>	6.28.4.3 (C)

**Note:** If your facility does not have a rail terminal, write "NA" in both the "Yes" column and the "No" column in item 4 of the form in the railroad tank car row. Similar option is also available if there is no cargo tank vehicle transfer station.

## Form 9.5 Evaluation of Low Emission Transfer Equipment

A	B	C		D	E	F
Item #	Description	Features		Proposed for the facility?		NFPA 58 Section Reference (2014 Edition)
				Yes	No	
1	Transfer into permanently mounted ASME containers on vehicles	Delivery nozzle and filler valve - Max. liquid release after transfer of 4 cm <sup>3</sup> (0.24 in <sup>3</sup> )	Fixed maximum liquid level gauge not used during transfer operations	<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.3 (A) and (B)
2	Transfer into stationary ASME containers delivery valve and nozzle combination	During product transfer or post transfer uncoupling of the hose, liquid product volume released to the atmosphere	Does not exceed 4 cm <sup>3</sup> (0.24 in <sup>3</sup> ) from a hose of nominal size 1 inch or smaller	<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (A)
			Does not exceed 15 cm <sup>3</sup> (0.91 in <sup>3</sup> ) from a hose of nominal size larger than 1 inch	<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (B)
3	Transfer into stationary ASME containers maximum filling limit	Do containers less than 2,001 gal (w.c.) have an overfilling prevention device or another approved device?		<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (F)
		Do containers greater than 2,000 gal (w.c.) have a float gauge or other non-venting device?		<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (E)
4	Transfer into stationary ASME containers fixed maximum liquid level gauge	Not used during routine transfer operations but may be used in calibrating other non-venting liquid level gauges in the container		<input type="checkbox"/>	<input type="checkbox"/>	6.28.5.4 (C) and (D)

**Note:** If the facility does not have a particular feature described in items 2 or 3, write "NA" in both the "Yes" and "No" columns corresponding to its row.

**Form 9.6**  
**Special Protection Measures – Passive Systems**

A Item #	B Special Protection Option	C Question	D Proposed for the facility?		E NFPA 58 Section Reference (2014 Edition)
			Yes	No	
			1	Container insulation	
	Insulation material complies with the requirements of NFPA 58?	<input type="checkbox"/>	<input type="checkbox"/>		6.27.5.1 and 6.27.5.2
2	Mounding of containers	Each container in the facility is mounded?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.5.3
		Mounding complies with each requirement under section 6.6.6.3 of NFPA 58?	<input type="checkbox"/>	<input type="checkbox"/>	6.6.6.3 and 6.27.5.3
3	Burying of containers	Each container in the facility is buried?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.5.4
		Buried containers comply with each requirement under section 6.6.6.1 of NFPA 58.	<input type="checkbox"/>	<input type="checkbox"/>	6.6.6.1 and 6.27.5.4

**Form 9.7**  
**Special Protection Measures – Active Systems**

A Item #	B Special Protection Option	C Question	D Is the Facility compliant?		E NFPA 58 Section Reference (2014 Edition)
			Yes	No	
1	Water spray systems	Are fixed water spray systems, complying with NFPA 15 requirements, used for each container in the facility?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.1
		Do fire responsive devices actuate water spray system automatically?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2
		Can the water spray systems be actuated manually also?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2
2	Monitor nozzle systems	Are the monitor nozzles located and arranged so that the water stream can wet the surfaces of all containers exposed to a fire?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.3
		Can the water stream from a monitor nozzle reach and wet the entire surface of, at least, one half of a length from one end of each of the containers it is designed to protect?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.3
		Do fixed monitor nozzles comply with NFPA 15 requirements?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.1
		Do fire responsive devices actuate the monitor nozzles?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2
		Can the monitor nozzles be actuated manually also?	<input type="checkbox"/>	<input type="checkbox"/>	6.27.6.2

### **Equivalent Protection to a Water Supply for Industrial and Bulk Facilities**

In the case where water supply is not available in or near the LP-Gas facility, or is inadequate, or it is prohibitively expensive to connect to a public or private water supply hydrant, alternative methods for providing protection should be considered. In lieu of providing a water supply, several alternatives are indicated in Table 9.1, which can offer an equivalency to a water supply system.

The intent of the controls identified in Table 9.1 is to maintain the entire system as a gas-tight entity. These methods include reducing the service life of equipment, increasing the design pressure rating of the system beyond the requirements of NFPA 58, or providing early detection and isolation of the system to ensure product control. This list is not exhaustive and is not ranked in an order of priority.

**Table 9.1  
Suggested Alternative Methods for Industrial and Bulk Plants  
That Do Not Pose a Hazard But Lack a Water Supply**

<b>Item #</b>	<b>Possible options to implement when adequate water supply is not available</b>
1	Reduce the service life of hoses.
2	Increase frequency of equipment inspection.
3	Establish a service life program for the maintenance of the container pressure relief devices. This could include the installation of a listed multiple port valve and certifying that the relief devices are properly set and maintained every 5 to 10 years.
4	Increase the design strength of the piping and fitting systems.
5	Install emergency shutoff valves in conjunction with container internal valves.
6	Install emergency shutoff valves downstream of transfer pump outlets and upstream of the vapor and liquid valves at the bulkhead.
7	Install pneumatic tubing along the facility boundary to serve as a perimeter fire detection system. This would provide protection of the facility against exposure fires.
8	Provide optical flame detection or linear heat detection, or a gas detection system connected to an isolation valve installed downstream of every liquid and vapor nozzle on the container. This system could also be monitored to send a signal to an alarm company that notifies the fire department of an event.
9	Increase the separation distances of internal facility exposures to the container. These exposures would include a site dumpster, idle or waste pallets and combustibles, and increasing the parking distances between the bobtails and transports in relation to the container.
10	Relocate overhead power lines away from all container and cylinder storage areas to protect against ignition in the event of a line dropping due to wind or power pole impact.
11	Eliminate all combustible vegetation within 30 feet of the LP-Gas container. This can be accomplished using gravel, or paving the site yard.
12	Install tanks using the mounding or burial method.